

Technical Information

Liquiphant FTL63

Vibronic
HART,
PROFINET over Ethernet-APL



Level switch for liquids specifically for the food and life sciences industries

Application

- Level switch for all liquids, for minimum or maximum detection in vessels, e.g. process tanks, storage tanks, and piping, even in hazardous areas
- Process temperature range: -50 to $+150$ °C (-58 to $+302$ °F)
- Pressures up to 64 bar (928 psi)
- Viscosities up to 10 000 mPa·s
- Ideal substitute for float switches; reliable function is not affected by flow, turbulence, air bubbles, foam, vibration, solids content or buildup

Your benefits

- Easy commissioning with plug and play functionality
- Certified, hygienic design (3-A, EHEDG, ASME BPE)
- Proven conformity with materials standards, e.g. EC 1935/2004, FDA, GB 4806, cGMP
- Functional safety: monitoring of the oscillation frequency of the vibrating fork
- Heartbeat Technology - verification and monitoring function on demand without interrupting the process
- With Bluetooth® wireless technology

Table of contents

About this document	4	Environment	20
Symbols	4	Ambient temperature range	20
Function and system design	5	Storage temperature	22
Measuring principle	5	Operating height	22
Measuring system	5	Climate class	22
Communication and data processing	5	Degree of protection	22
Dependability	6	Vibration resistance	22
Input	6	Shock resistance	23
Measured variable	6	Mechanical load	23
Measuring range	6	Pollution degree	23
Output	6	Electromagnetic compatibility (EMC)	23
Output signal	6	Process	23
Signal on alarm	6	Process temperature range	23
Load	7	Thermal shock	23
Damping	7	Process pressure range	23
Switch output	7	Overpressure limit	24
Ex connection data	7	Medium density	24
Protocol-specific data	7	Viscosity	24
HART data	9	Pressure tightness	24
Heartbeat Technology	9	Solids contents	24
Power supply	10	Mechanical construction	24
Terminal assignment	10	Design, dimensions	24
Available device plugs	10	Dimensions	25
Supply voltage	11	Weight	33
Electrical connection	11	Materials	33
Potential equalization	11	Surface roughness	35
Terminals	12	Operability	36
Cable entries	12	Operation concept	36
Cable specification	12	Languages	36
Overvoltage protection	13	Local operation	36
Performance characteristics	13	Local display	37
Reference operating conditions	13	Remote operation	38
Take switch point into consideration	13	Supported operating tools	39
Maximum measurement error	14	System integration	39
Resolution	14	HistoROM data management	39
Response time	14	Certificates and approvals	40
Dynamic behavior, current output	14	CE mark	40
Dynamic behavior, digital output	14	RCM marking	40
Hysteresis	15	Ex approval	40
Non-repeatability	15	Material compliance for contact with food	40
Influence of the process temperature	15	Hygienic design compliance	40
Influence of the process pressure	15	cGMP	40
Influence of the process medium density (at room temperature and normal pressure)	15	General material compliance	40
Installation	16	Overfill protection system	41
Mounting location, orientation	16	Functional safety	41
Installation instructions	16	Radio approval	41
Installing the device in piping	18	CRN approval	41
Aligning the cable entry	18	TSE (BSE) compliance (ADI free - Animal Derived Ingredients)	41
Special installation instructions	19	Pressure equipment with permitted pressure less than 200 bar, no pressure-bearing volume	41
		Process seal as per ANSI/ISA 12.27.01	41
		EAC conformity	41
		ASME B 31.3/31.1	42

ASME BPE	42
HART certification	42
PROFINET over Ethernet-APL certification	42
Ordering information	42
Service	42
Test reports, declarations and inspection certificates	43
Test, certificate, declaration	43
TAG	43
Application packages	43
Heartbeat Technology	43
Heartbeat Diagnostics	44
Heartbeat Verification	44
Heartbeat Monitoring	44
Proof testing (HART)	44
Accessories	45
Device Viewer	45
Weather protection cover: 316L, XW112	45
Weather protection cover, plastic, XW111	45
Weld-in adapter	46
M12 socket	46
Field Xpert SMT70	47
DeviceCare SFE100	47
FieldCare SFE500	47
Documentation	47
Standard documentation	47
Supplementary device-dependent documentation	47
Registered trademarks	48

About this document

Symbols

Safety symbols



This symbol alerts you to a dangerous situation. Failure to avoid this situation will result in serious or fatal injury.



This symbol alerts you to a potentially dangerous situation. Failure to avoid this situation can result in serious or fatal injury.



This symbol alerts you to a potentially dangerous situation. Failure to avoid this situation can result in minor or medium injury.



This symbol alerts you to a potentially harmful situation. Failure to avoid this situation can result in damage to the product or something in its vicinity.

Tool symbols



Open-ended wrench

Electrical symbols



Ground connection

Grounded clamp, which is grounded via a grounding system.



Protective earth (PE)

Ground terminals, which must be grounded prior to establishing any other connections. The ground terminals are located on the inside and outside of the device.

Symbols for certain types of Information



Permitted

Procedures, processes or actions that are permitted.



Forbidden

Procedures, processes or actions that are forbidden.



Tip

Indicates additional information



Reference to documentation



Reference to another section

1., 2., 3. Series of steps

Symbols in graphics

A, B, C ... View

1, 2, 3 ... Item numbers



Hazardous area



Safe area (non-hazardous area)

Communication-specific symbols



Bluetooth® wireless technology

Wireless data transmission between devices over a short distance via radio technology.

List of abbreviations

PN

Nominal pressure

MWP

Maximum working pressure

The maximum working pressure is indicated on the nameplate.

DTM

Device Type Manager

Operating tool

The term "operating tool" is used in place of the following operating software:

- FieldCare/DeviceCare for operation via HART communication and PC
- SmartBlue app for operation using an Android or iOS smartphone or tablet

PLC

Programmable logic controller (PLC)

Graphic conventions



- Installation, explosion and electrical connection drawings are presented in simplified format
- Devices, assemblies, components and dimensional drawings are presented in reduced-line format
- Dimensional drawings are not to-scale representations; the dimensions indicated are rounded off to 2 decimal places
- Unless otherwise described, flanges are presented with sealing surface form EN 1091-1, B2; ASME B16.5, RF; JIS B2220, RF

Function and system design

Measuring principle

The sensor's vibrating fork vibrates at its natural frequency. As soon as the liquid covers the vibrating fork, the oscillation frequency decreases. The change in frequency causes the level switch to switch.

Point level measurement

Maximum or minimum detection for liquids in tanks or pipes in all industries. Suitable for leakage monitoring, pump dry-running protection or overflow prevention, for example.

Specific versions are suitable for use in hazardous areas.

The level switch differentiates between the "covered" and "not covered" conditions.

Depending on the MIN (minimum detection) or MAX (maximum detection) modes, there are two possibilities in each case: OK status and demand mode.


OK status

- In MIN mode, the vibrating fork is covered, e.g. pump dry-run protection
- In MAX mode, the vibrating fork is not covered, e.g. overflow protection

Demand mode

- In MIN mode, the vibrating fork is not covered, e.g. pump dry-run protection
- In MAX mode, the vibrating fork is covered, e.g. overflow protection system

Measuring system

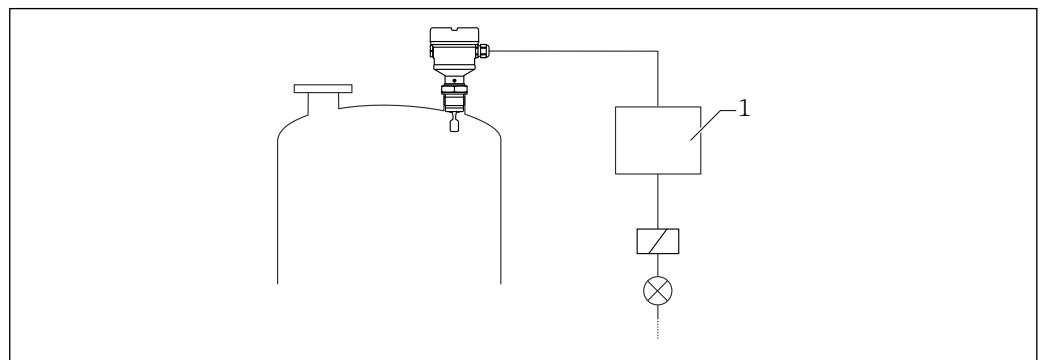

A0045801

1 Example of a measuring system

1 Switching unit, PLC etc.

Communication and data processing

- 4 to 20 mA with HART communication protocol
- PROFINET over Ethernet-APL: 10BASE-T1L communication protocol
- Bluetooth® wireless technology (optional)

Dependability**IT security**

The manufacturer warranty is valid only if the product is installed and used as described in the Operating Instructions. The product is equipped with security mechanisms to protect it against any inadvertent changes to the settings.

IT security measures, which provide additional protection for the product and associated data transfer, must be implemented by the operators themselves in line with their security standards.

Input

Measured variable

The point level signal is triggered according to the operating mode (minimum or maximum detection) when the level exceeds or falls below the relevant point level.

Measuring range

Depends on the installation location and the pipe extension ordered
Maximum sensor length 3 m (9.8 ft)

Output

Output signal**HART****SIO mode**

8/16 mA (SIO mode) with superimposed digital communication protocol HART, 2-wire

Continuous operation

4 to 20 mA proportional to the oscillation frequency with superimposed digital communication protocol HART, 2-wire

For continuous current output, one of the following modes of operation can be selected:

- 4.0 to 20.5 mA
- NAMUR NE 43: 3.8 to 20.5 mA (factory setting)
- US mode: 3.9 to 20.8 mA

PROFINET over Ethernet-APL

10BASE-T1L, 2-wire 10 Mbit/s

Signal on alarm

Signal on alarm in accordance with NAMUR recommendation NE 43.

4 to 20 mA HART:


- Maximum alarm: can be set from 21.5 to 23 mA
- Minimum alarm: < 3.6 mA (factory setting)

PROFINET over Ethernet-APL:

- According to "Application layer protocol for decentralized periphery", Version 2.4
- Diagnostics according to PROFINET PA Profile 4.02

Load

4 to 20 mA passive, HART

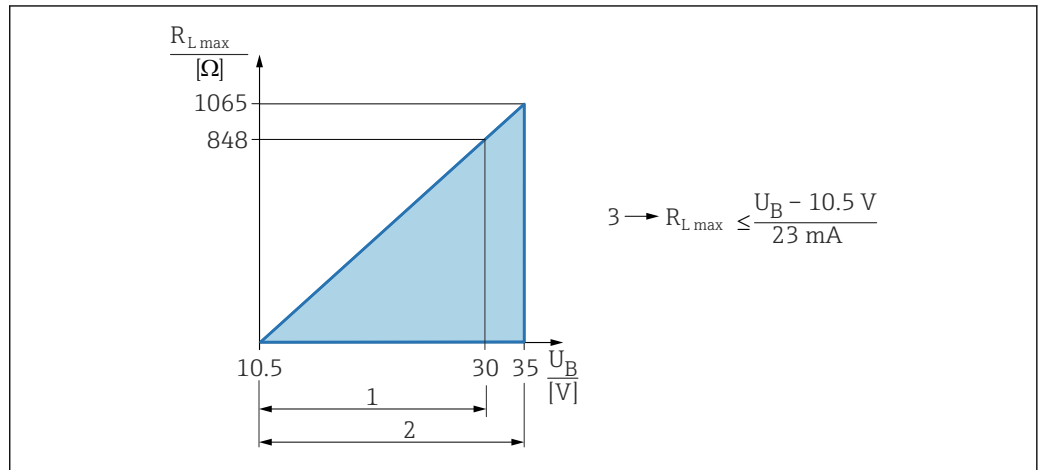

- 1 Power supply DC 10.5 to 30 V Ex i
 - 2 Power supply DC 10.5 to 35 V, for other types of protection and non-certified device versions
 - 3 $R_{L\max}$ maximum load resistance
- U_B Supply voltage



Operation via handheld terminal or PC with operating program: take minimum communication resistance of 250 Ω into consideration.

Damping

HART

- The damping affects all outputs, including the output signal and the display.
- It is only available in 4 to 20 mA continuous operation and has no effect on the SIO mode.
- The damping can be adjusted continuously between 0 to 999 s using the local display, Bluetooth® wireless technology, handheld control unit, or PC with operating program.
- Factory setting: 1 s

PROFINET over Ethernet-APL

- The damping can only be activated for analog inputs 1 to 3.
- The damping can be adjusted continuously between 0 and 999 s.

The device uses various modules for cyclic data exchange with the control system.

Switch output

Preconfigured switching delay available for order:

- 0.5 s when the vibrating fork is covered and 1.0 s when it is uncovered (factory setting)
- 0.25 s when the vibrating fork is covered and 0.25 s when it is uncovered
- 1.5 s when the vibrating fork is covered and 1.5 s when the vibrating fork is uncovered
- 5.0 s when the vibrating fork is covered and 5.0 s when the vibrating fork is uncovered



The user can also set the switching delays for when the fork is covered and uncovered in the range from 1 to 60 seconds independently of one another.

(operation via display, Bluetooth® wireless technology or web browser, FieldCare, DeviceCare, AMS, PDM)

Ex connection data

See safety instructions (XA): All data relating to explosion protection are provided in separate Ex documentation and are available from the Downloads area of the Endress+Hauser website. The Ex documentation is supplied as standard with all devices approved for use in explosion hazardous areas.

Protocol-specific data

HART

- Manufacturer ID: 17 (0x11)
- Device type code: 0x11C4
- Device revision: 1
- HART specification: 7

- DD revision: 1
- Device description files (DTM, DD) information and files at:
 - www.endress.com
 - www.fieldcommgroup.org
- HART load: min. 250 Ω

HART device variables (preset at the factory)

The following measured values are assigned to the device variables at the factory:

Device variable	Measured value
Primary variable (PV) parameter (Primary variable) ¹⁾	Level limit detection ²⁾
Secondary variable (SV) parameter (Secondary variable)	Sensor frequency ³⁾
Tertiary variable (TV) parameter (Third variable)	Fork state ⁴⁾
Quaternary variable (QV) parameter (Quaternary variable)	Sensor temperature

- 1) **Primary variable (PV)** parameter is always applied to the current output.
- 2) In limit detection, the initial state depends on the **Fork state** parameter (covered or uncovered) and the safety function (MIN or MAX)
- 3) Sensor frequency is the oscillation frequency of the fork
- 4) Fork state shows the status of the vibrating fork (**Fork covered** option/**Fork uncovered** option)

Choice of HART device variables

- Level limit detection
- Sensor frequency
- Fork state
- Sensor temperature
- Terminal current
The terminal current is the read-back current on terminal block. Visibility depends on order options or device settings
- Terminal voltage
Visibility depends on order options or device settings

Supported functions

- Burst mode
- Additional transmitter status
- Device locking

PROFINET over Ethernet-APL

Protocol	Application layer protocol for decentral device periphery and distributed automation, Version 2.4
Communication type	Ethernet Advanced Physical Layer 10BASE-T1L
Conformity class	Conformance class B
Netload Class	Netload Class II
Baud rates	Automatic 10 Mbit/s with full-duplex detection
Periods	From 32 ms
Polarity	Auto-polarity for automatic correction of crossed TxD and RxD pairs
Media Redundancy Protocol (MRP)	Yes
System redundancy support	System redundancy S2 (2 AR with 1 NAP)
Device profile	Application interface identifier 0xB360 Generic device (PA 4.02 Profile Discrete Input)
Manufacturer ID	0x11
Device type ID	0xA1C4

Device description files (GSD, FDI, DTM, DD)	Information and files at: ▪ www.endress.com On the product page for the device: Documents/Software → Device drivers ▪ www.profibus.org
Supported connections	▪ 2 x AR (IO Controller AR) ▪ 1 x AR (IO-Supervisor Device AR connection allowed) ▪ 1 x Input CR (Communication Relation) ▪ 1 x Output CR (Communication Relation) ▪ 1 x Alarm CR (Communication Relation)
Configuration options for device	▪ Manufacturer-specific software (FieldCare, DeviceCare) ▪ Web browser ▪ Device master file (GSD), can be read out via the integrated web server of the device ▪ DIP switch for setting the service IP address
Configuration of the device name	▪ DCP protocol ▪ Process Device Manager (PDM) ▪ Integrated web server
Supported functions	▪ Identification & Maintenance Simple device identification via: ▪ Control system ▪ Nameplate ▪ Measured value status The process variables are communicated with a measured value status ▪ Blinking feature via the local display for simple device identification and assignment ▪ Device operation via operating tools (e.g. FieldCare, DeviceCare, SIMATIC PDM)
System integration	For information on system integration, see  Operating Instructions ▪ Cyclic data transmission ▪ Overview and description of the modules ▪ Status coding ▪ Startup parameterization ▪ Factory setting

HART data

- Minimum start-up voltage: 10.5 V
- Start-up current: > 3.6 mA
- Start-up time: < 8 s
- Minimum operating voltage: 10.5 V
- Multidrop current: 4 mA

Heartbeat Technology

Heartbeat Technology modules

Heartbeat Technology comprises 3 modules. These three modules combined check, evaluate and monitor device functionality and process conditions.




- Heartbeat Diagnostics
- Heartbeat Verification
- Heartbeat Monitoring

Power supply

Terminal assignment

Single compartment housing

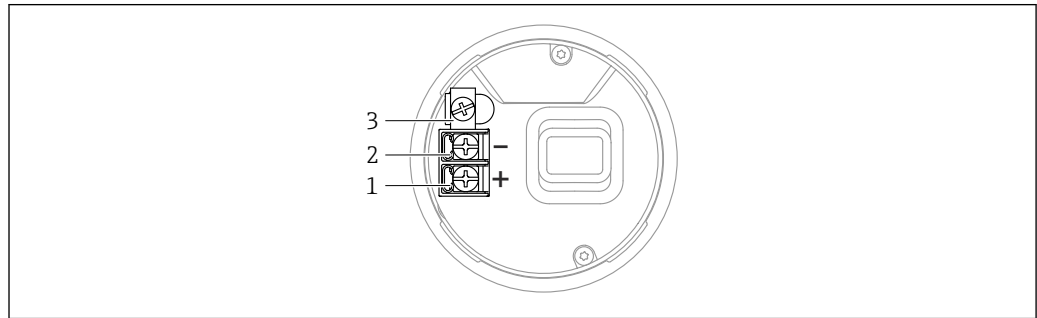


A0042594

2 Connection terminals and ground terminal in the connection compartment, single compartment housing

- 1 Positive terminal
- 2 Negative terminal
- 3 Internal ground terminal

Dual-compartment housing, L-form

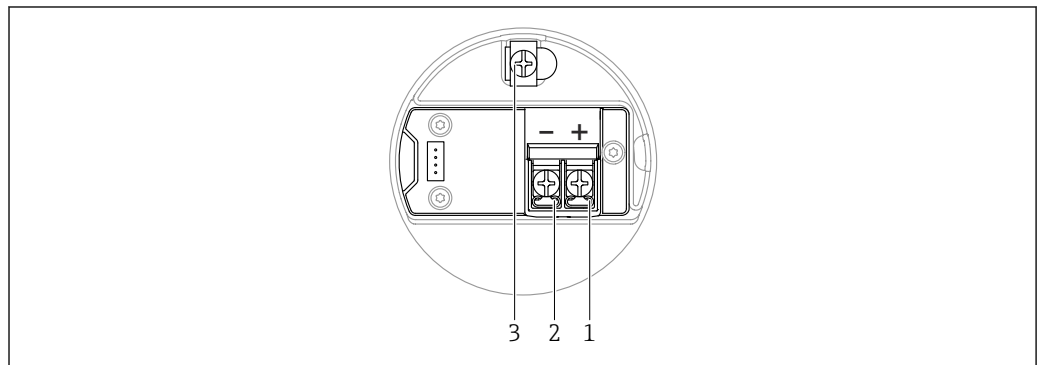

A0045842

3 Connection terminals and ground terminal in the connection compartment, dual-compartment housing, L-form

- 1 Plus terminal
- 2 Minus terminal
- 3 Internal ground terminal

Available device plugs




In the case of devices with a plug, it is not necessary to open the housing for connection purposes.

Various M12 sockets are available as accessories for devices with M12 plugs.



For more details, see the "Accessories" section.

M12 plug with pin assignment for HART

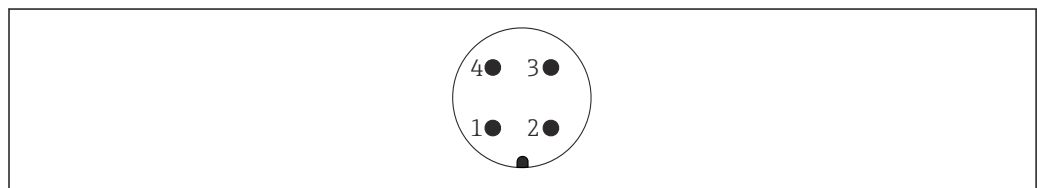


A0011175

4 View of the connection on the device

- 1 Signal +
- 2 Not used
- 3 Signal -
- 4 Ground

M12 plug with pin assignment for PROFINET over Ethernet-APL

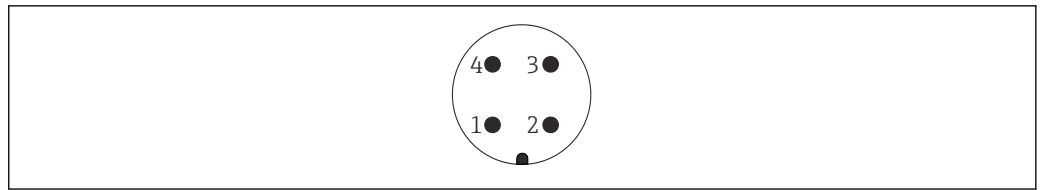

A0011175

5 View of the connection on the device

- 1 APL signal -
- 2 Ethernet-APL signal +
- 3 Shielding
- 4 Not used

Supply voltage

HART

- U = DC 10.5 to 35 V (Ex d, Ex e, not Ex)
- U = DC 10.5 to 30 V (Ex i)
- Rated current: 4 to 20 mA HART



- The power unit must be tested to ensure it meets safety requirements (e.g. PELV, SELV, Class 2) and must comply with the relevant protocol specifications.
- Comply with the following according to IEC 61010-1: provide a suitable circuit breaker for the device.

Depending on the supply voltage at the moment the device is switched on, the backlight is switched off (supply voltage < 13 V).

PROFINET over Ethernet-APL

APL power class A (DC 9.6 to 15 V 540 mW)




- The APL field switch must be tested to ensure it meets safety requirements (e.g., PELV, SELV, Class 2) and must comply with the relevant protocol specifications.

Electrical connection

Connection example

PROFINET over Ethernet-APL

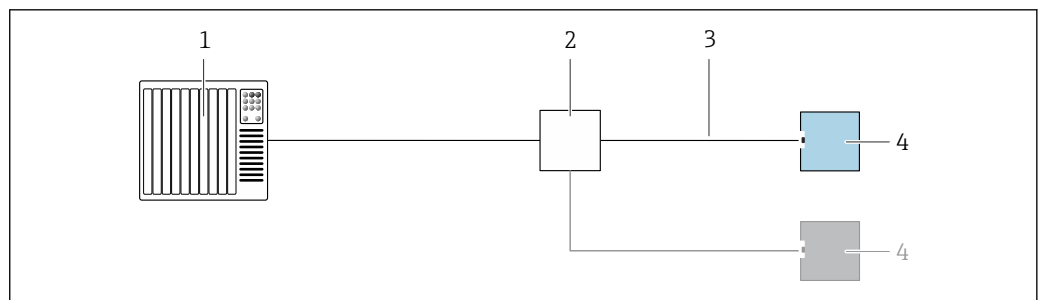

A0045802

6 Connection example for PROFINET over Ethernet-APL

- 1 Automation system
- 2 APL field switch
- 3 Observe cable specifications
- 4 Transmitter


Potential equalization



Ignitable sparks or excessively high surface temperatures.

Explosion hazard!

- Please refer to the separate documentation on applications in hazardous areas for the safety instructions.

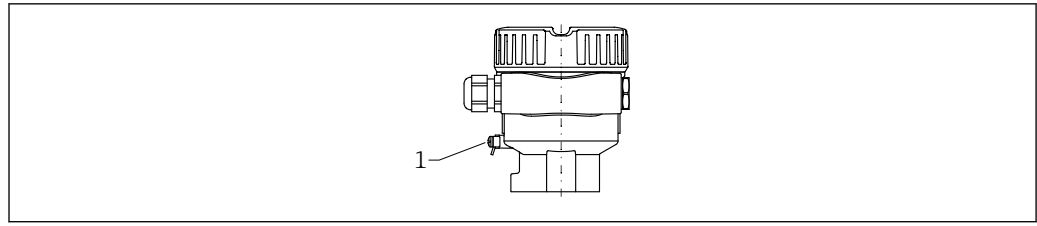

A0045830

1 Ground terminal for connecting the potential matching line (example)

i If necessary, the potential matching line can be connected to the external ground terminal of the transmitter before the device is connected.


i For optimum electromagnetic compatibility:

- Potential matching line as short as possible
- Observe a cross-section of at least 2.5 mm² (14 AWG)

Terminals

- Supply voltage and internal ground terminal: 0.5 to 2.5 mm² (20 to 14 AWG)
- External ground terminal: 0.5 to 4 mm² (20 to 12 AWG)

Cable entries

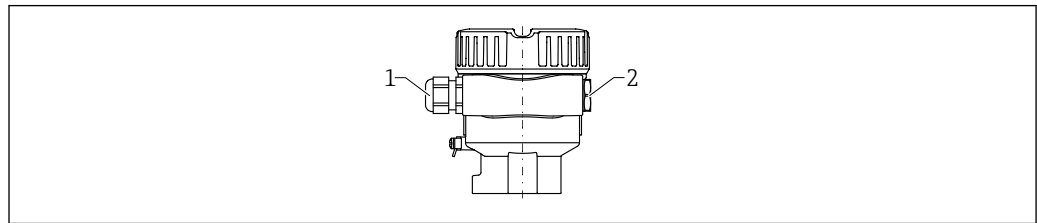

A0045831

7 Example

- 1 Cable entry
2 Blind plug

The type of cable entry depends on the device version ordered.

Cable specification

The cable outer diameter depends on the cable entry used.

Cable outer diameter:

- Coupling, plastic: Ø5 to 10 mm (0.2 to 0.38 in)
- Coupling, nickel-plated brass: Ø7 to 10.5 mm (0.28 to 0.41 in)
- Coupling, stainless steel: Ø7 to 12 mm (0.28 to 0.47 in)
- Coupling, stainless steel, hygienic: Ø7 to 10 mm (0.28 to 0.38 in)

PROFINET over Ethernet-APL

Rated cross-section

Protective earth or grounding of the cable shield
> 1 mm² (17 AWG)

Reference cable type

The reference cable type for APL segments is fieldbus cable type A, MAU type 1 and 3 (specified in IEC 61158-2). This cable meets the requirements for intrinsically safe applications according to IEC TS 60079-47 and can also be used in non-intrinsically safe applications.

Cable type	A
Cable capacitance	45 to 200 nF/km
Loop resistance	15 to 150 Ω/km
Cable inductance	0.4 to 1 mH/km

Further details are provided in the Ethernet-APL Engineering Guideline (<https://www.ethernet-apl.org>).

Overvoltage protection

Devices without optional overvoltage protection

Equipment from Endress+Hauser fulfills the requirements of the product standard IEC 61326-1 (Table 2 Industrial Environment).

Depending on the type of connection (DC power supply, input line, output line) and in accordance with IEC 6132 6-1, different test levels are used to prevent transient overvoltages (IEC 61000-4-5 Surge): Test level for DC power supply lines and IO lines: 1 000-V-wire to ground

Devices with optional overvoltage protection

- Spark-over voltage: min. DC 400 V
- Tested in accordance with:
 - IEC 60079-14 Subsection 12.3
 - IEC 60060-1 Section 7
- Nominal discharge current: 10 kA

NOTICE

The device can be damaged by excessively high electrical voltages.

- Always ground the device with integrated overvoltage protection.

Overvoltage category

Overvoltage category II

Performance characteristics

Reference operating conditions

- As per IEC 62828-2
- Ambient temperature: +23 °C (+73 °F)
- Process temperature: +23 °C (+73 °F)
- Humidity ϕ = constant, in the range: 5 to 80 % rF $\pm$ 5 %
- Medium density (water): 1 g/cm³ (62.4 lb/ft³)
- Medium viscosity: 1 mPa·s
- Atmospheric pressure p_A = constant, in the range: 860 to 1 060 mbar (12.47 to 15.37 psi)
- Process pressure: atmospheric pressure/unpressurized
- Sensor installation: vertically and from above
- Density selection switch : > 0.7 g/cm³ (43.7 lb/ft³)
- Switch direction of sensor: uncovered to covered
- Supply voltage: DC 24 V $\pm$ 3 V
- In combination with HART:
 - Load with HART: 250 Ω


Take switch point into consideration

The following are typical switch points, depending on the orientation of the level switch.

Water +23 °C (+73 °F)



Minimum distance between the tuning fork and the tank wall or pipe wall: 10 mm (0.39 in)

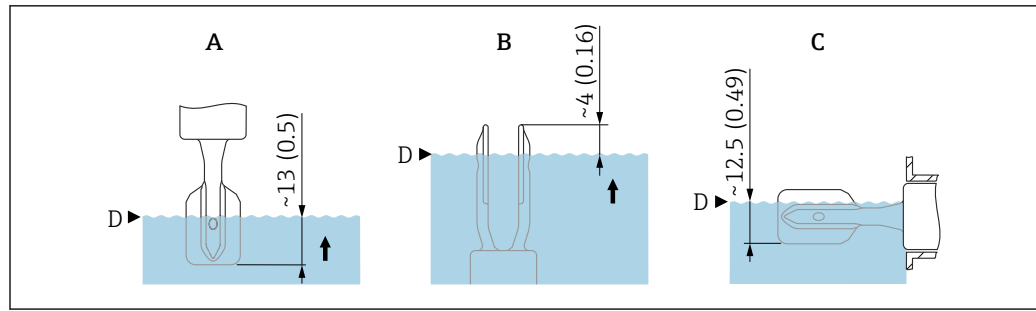

A0037915

8 Typical switch points. Unit of measurement mm (in)

- A Installation from above
 B Installation from below
 C Installation from the side
 D Switch point

Maximum measurement error

At reference operating conditions: max. ± 1 mm (0.04 in) at switch point


Resolution

HART
 Current output: $< 1 \mu\text{A}$

Response time

Dead time, time constant, settling time

Presentation of the dead time, time constant and settling time as per DIN EN 61298-2

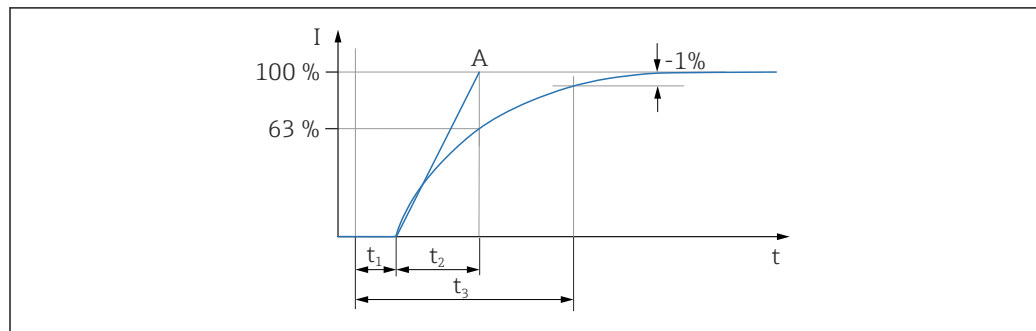

A0042012

- t_1 Dead time
 t_2 Time constant
 t_3 Settling time
 A Stable full scale value

Dynamic behavior, current output

- HART**
- Dead time (t_1): 100 ms
 - Time constant T63 (t_2): can be set from 0 to 999 s
 - Settling time (t_3): minimum 250 ms

Dynamic behavior, digital output

- HART**
- Dead time (t_1):
 - Minimum: 200 ms
 - Maximum: 800 ms
 - Time constant T63 (t_2): can be set from 0 to 999 s
 - Settling time (t_3): minimum 200 ms

Reading cycle:

- Acyclic: maximum 3/s, typically 1/s (depending on command # and number of preambles)
- Cyclic (burst): maximum 3/s, typically 2/s

The device commands the burst mode function for cyclic value transmission via the HART communication protocol.


Cycle time (update time):

Cyclic (burst): at least 300 ms

PROFINET over Ethernet-APL

- Dead time (t_1):
Maximum: 32 ms
 - Time constant T63 (t_2): 0 s
 - Settling time (t_3): 0 ms
- Cycle time (update time): at least 32 ms

Hysteresis	Typically 2.5 mm (0.1 in)
Non-repeatability	0.5 mm (0.02 in)
Influence of the process temperature	The switch point moves from +1.4 to -2.6 mm (+0.06 to -0.1 in) in the temperature range of -50 to +150 °C (-58 to +302 °F)
Influence of the process pressure	The switch point moves from 0 to 2.6 mm (0 to 0.1 in) in the pressure range of -1 to +64 bar (-14.5 to +928 psi)
Influence of the process medium density (at room temperature and normal pressure)	

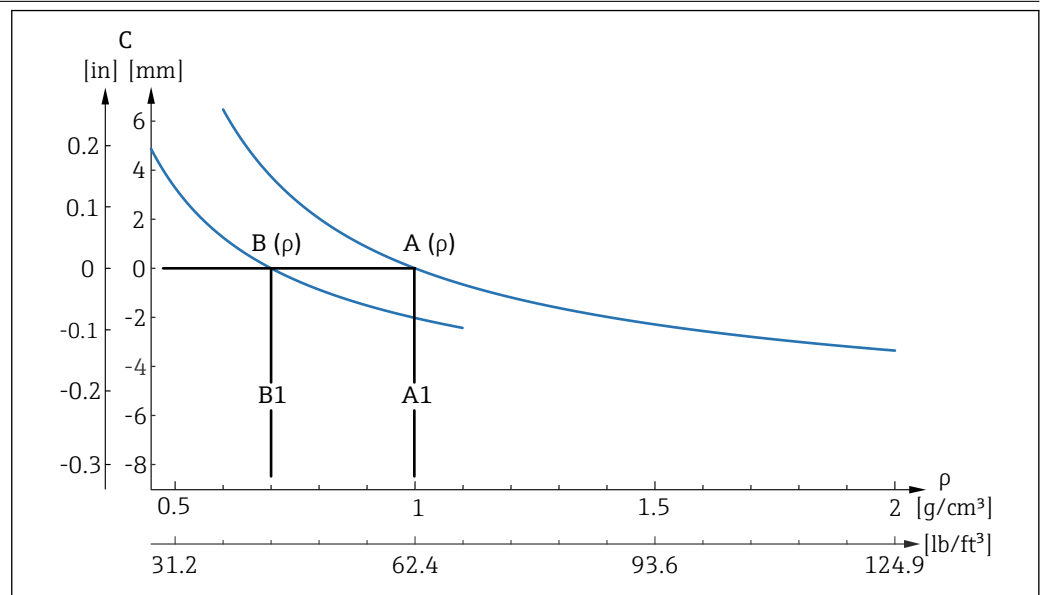

9 Switch point deviation over density, 316L

- A Set density (ρ) > 0.7 g/cm³ (43.7 lb/ft³)
- A1 Reference operating condition $\rho = 1$ g/cm³ (62.4 lb/ft³)
- B Set density (ρ) > 0.5 g/cm³ (31.2 lb/ft³)
- B1 Reference operating condition $\rho = 0.7$ g/cm³ (43.7 lb/ft³)
- C Switch point deviation

Density setting


- TC_{typ.}, [mm/10 k]
 - $\rho > 0.7$ g/cm³ (43.7 lb/ft³): -0.2
 - $\rho > 0.5$ g/cm³ (31.2 lb/ft³): -0.2
- Pressure_{typ.}, [mm/10 bar]
 - $\rho > 0.7$ g/cm³ (43.7 lb/ft³): -0.3
 - $\rho > 0.5$ g/cm³ (31.2 lb/ft³): -0.4

Installation

Mounting location, orientation

Mounting instructions

- Any orientation for compact version or version with a pipe length of up to 500 mm (19.7 in) approx.
- Vertical orientation from above for device with long pipe
- Minimum distance between the tuning fork and the tank wall or pipe wall: 10 mm (0.39 in)

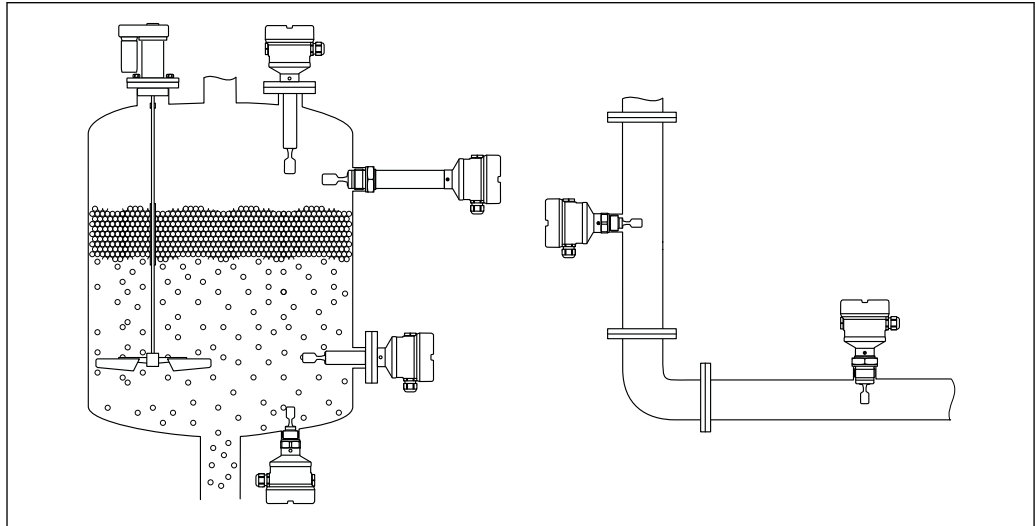

10 Installation examples for a vessel, tank or pipe


Installation instructions

Take viscosity into consideration

- i** Viscosity values
- Low viscosity: $< 2\,000\text{ mPa}\cdot\text{s}$
 - High viscosity: $> 2\,000\text{ to }10\,000\text{ mPa}\cdot\text{s}$

Low viscosity

- i** Low viscosity, e.g. water: $< 2\,000\text{ mPa}\cdot\text{s}$
- It is permitted to position the tuning fork within the installation socket.

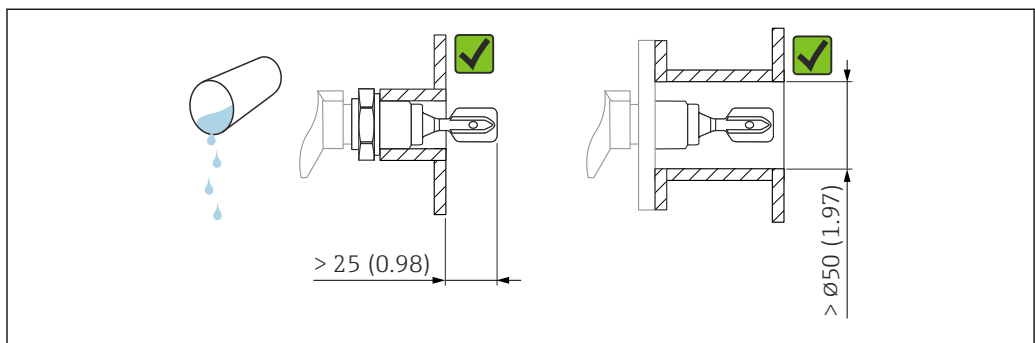

11 Installation example for low-viscosity liquids. Unit of measurement mm (in)


High viscosity

NOTICE

Highly viscous liquids may cause switching delays.

- ▶ Make sure that the liquid can run off the tuning fork easily.
- ▶ Deburr the socket surface.

- i** High viscosity, e.g. viscous oils: $\leq 10\,000\text{ mPa}\cdot\text{s}$
- The tuning fork must be located outside the installation socket!

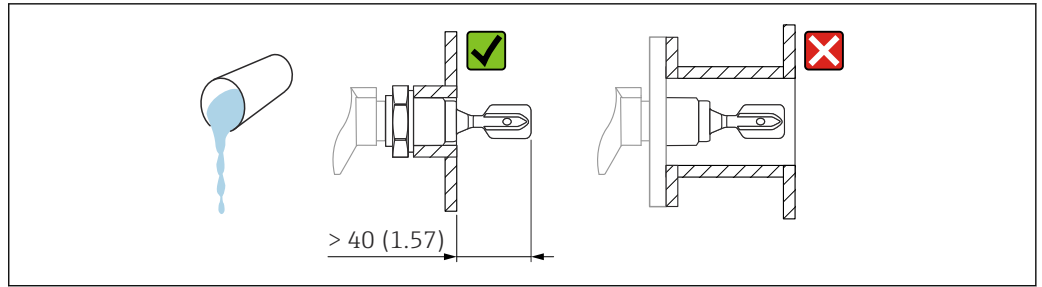


A0037948

12 Installation example for a highly viscous liquid. Unit of measurement mm (in)

Avoid buildup

- Use short installation sockets to ensure that the tuning fork projects freely into the vessel
- Leave sufficient distance between the buildup expected on the tank wall and the tuning fork

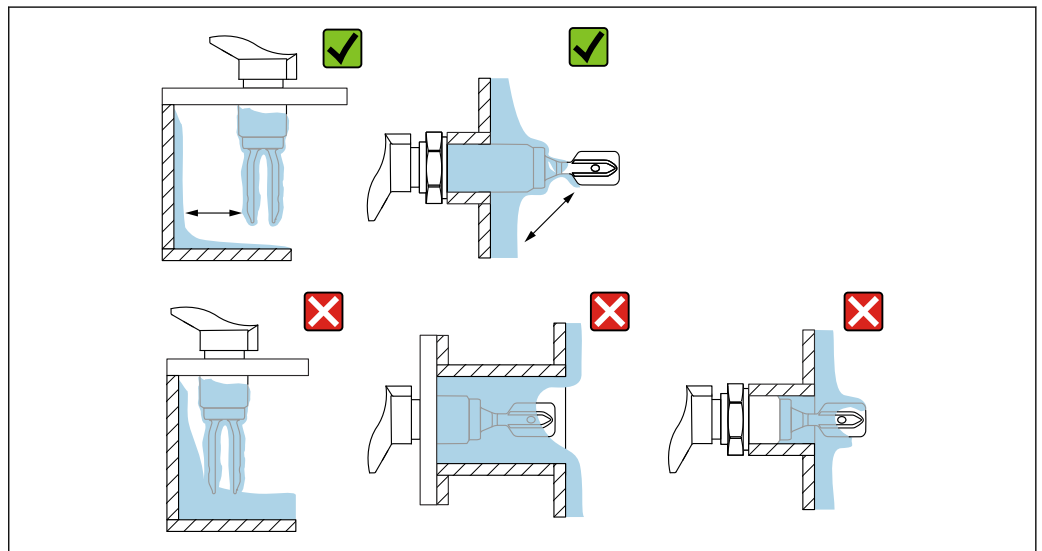


A0033239

13 Installation examples for a highly viscous process medium

Take clearance into consideration

Allow sufficient space outside the tank for mounting, connection and settings involving the electronic insert.

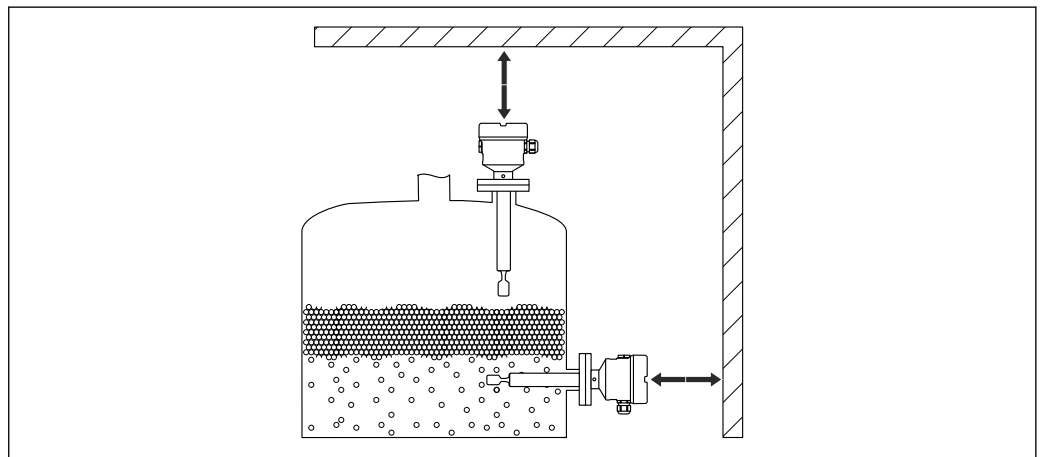

A0033236


14 Take clearance into consideration

Align the vibrating fork using the marking

The vibrating fork can be aligned using the marking in such a way that the medium drains off easily and buildup is avoided.

- Markings for threaded connections: Circle (material specification/thread designation opposite)
- Markings for flange or clamp connections: Line or double line

i In addition, the threaded connections have a matrix code that is **not** used for alignment.

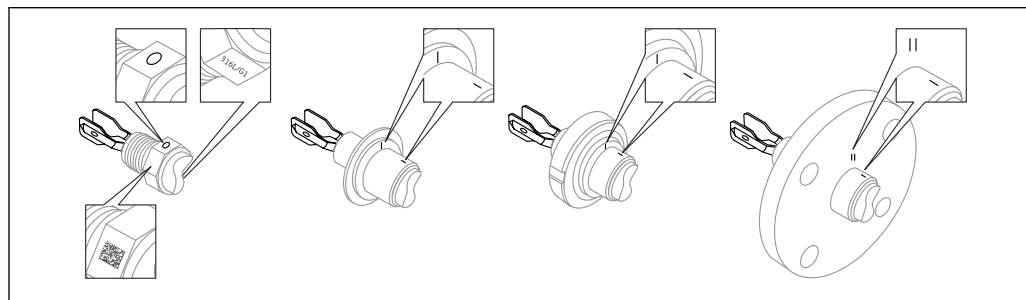


A0039125

15 Position of the vibrating fork when installed horizontally in the vessel using the marking

Installing the device in piping

- Flow velocity up to 5 m/s with a viscosity of 1 mPa·s and density of 1 g/cm³ (62.4 lb/ft³) (SGU). Check for correct functioning in the event of other process medium conditions.
- The flow will not be significantly impeded if the tuning fork is correctly aligned and the marking is pointing in the direction of flow.
- The marking is visible when installed

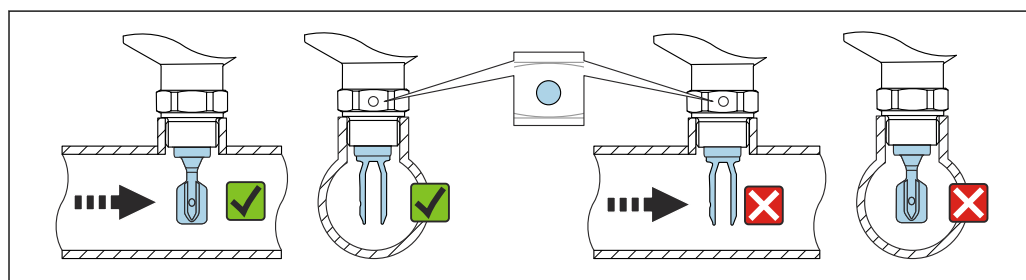

A0034851


16 Installation in pipes (take fork position and marking into consideration)

Aligning the cable entry

All housings can be aligned. Forming a drip loop on the cable prevents moisture from entering the housing.

Housing without set screw

The device housing can be rotated up to 350°.

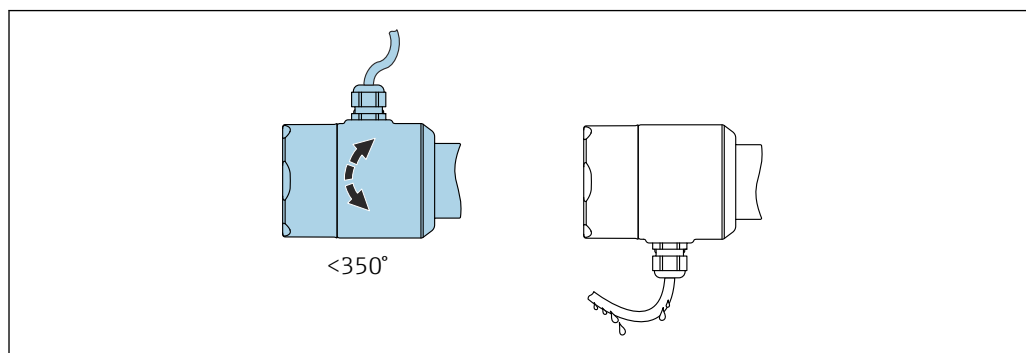

A0052359


17 Housing without set screw; form a drip loop on the cable.

Housing with set screw



In the case of housings with locking screw:

- The housing can be turned and the cable aligned by loosening the locking screw. A cable loop for draining prevents moisture in the housing.
- The locking screw is not tightened when the device is delivered.

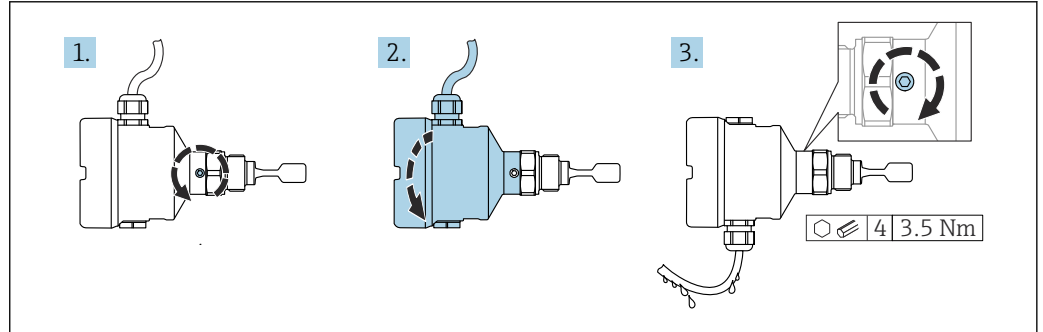


A0037347

18 Housing with external set screw; form a drip loop on the cable

Special installation instructions

Vessel with heat insulation

If process temperatures are high, the device should be included in the vessel insulation system to prevent the electronics from heating as a result of thermal radiation or convection. The insulation in this case should not be higher than the neck of the device.

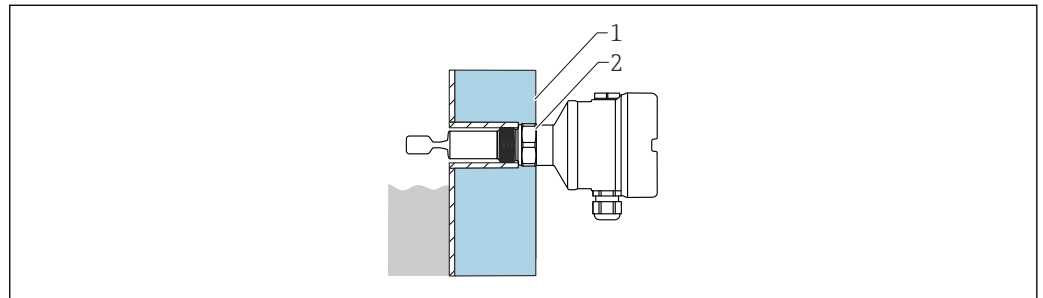


A0051616

19 Example of a vessel with heat insulation

- 1 Vessel insulation
- 2 Insulation (up to the housing neck max.)

Support the device

Support the device in the event of severe dynamic load. Maximum lateral loading capacity of the pipe extensions and sensors: 75 Nm (55 lbf ft).

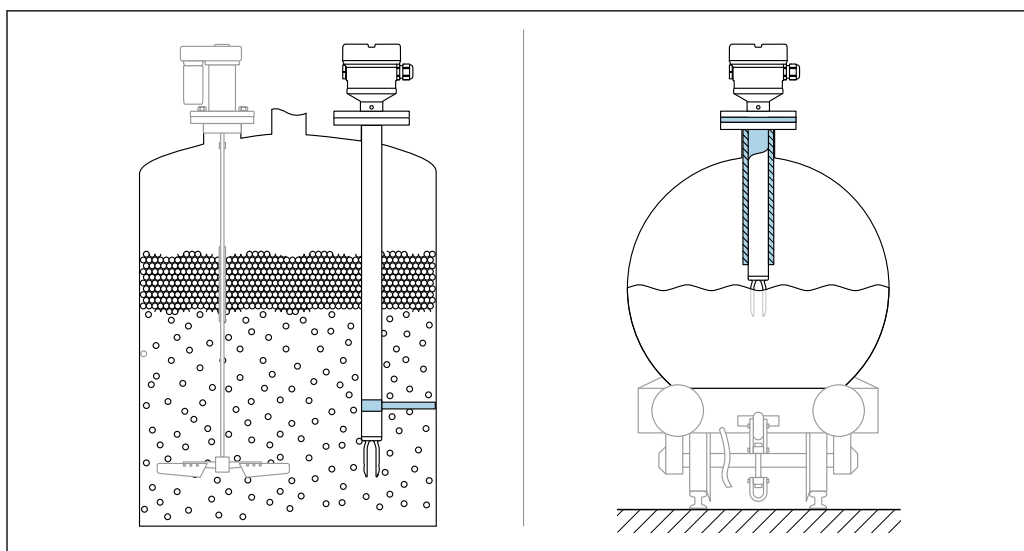


A0031874

20 Examples of support in the event of dynamic load

Weld-in adapter with leakage hole

Position the weld-in adapter so that the leakage hole points downwards. This allows any leakage to be detected at an early stage, as the escaping medium becomes visible.

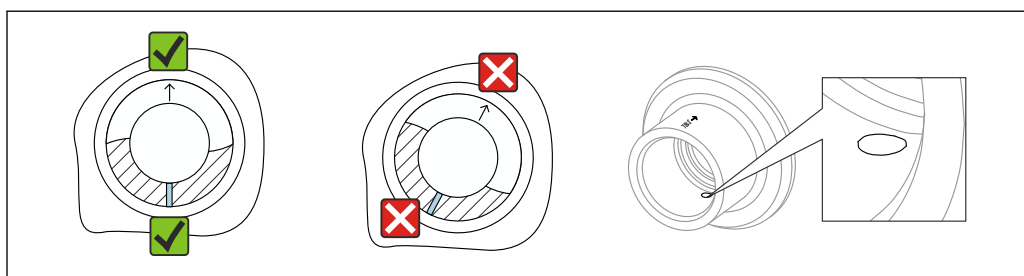

A0039230

21 Weld-in adapter with leakage hole

Environment

Ambient temperature range

The following values apply up to a process temperature of +90 °C (+194 °F). At higher process temperatures, the permitted ambient temperature is reduced (see diagram).

- Without LCD display: -40 to +70 °C (-40 to +158 °F)
- With LCD display: -40 to +70 °C (-40 to +158 °F) with limitations in optical properties, such as display speed and contrast
- Can be used without limitations: -20 to +60 °C (-4 to +140 °F)

Optionally available in combination with HART:


- -50 °C (-58 °F) with restricted operating life and performance
- -60 °C (-76 °F) with restricted operating life and performance,
- Below -50 °C (-58 °F): devices can be permanently damaged

The following ambient temperature applies over the entire process temperature range for devices with a temperature spacer: +70 °C (+158 °F)


Outdoor operation in strong sunlight:

- Mount the device in a shaded location
- Avoid direct sunlight, particularly in warmer climatic regions
- Use a protective cover, can be ordered as an accessory


Single compartment housing (plastic)

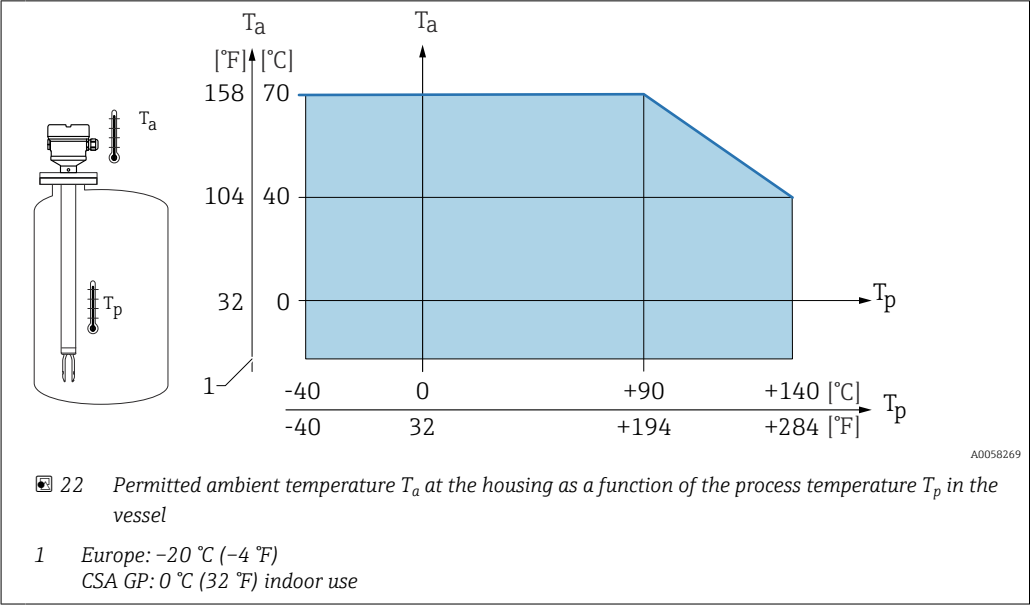

Single compartment and dual compartment housing (aluminum, coated)

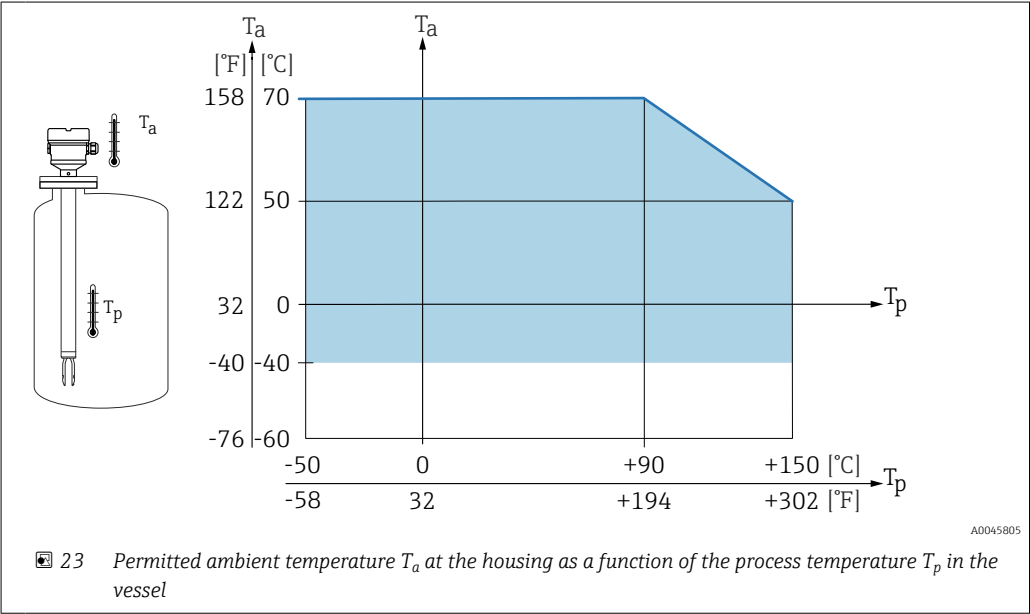

Single compartment housing (316 L, hygiene)

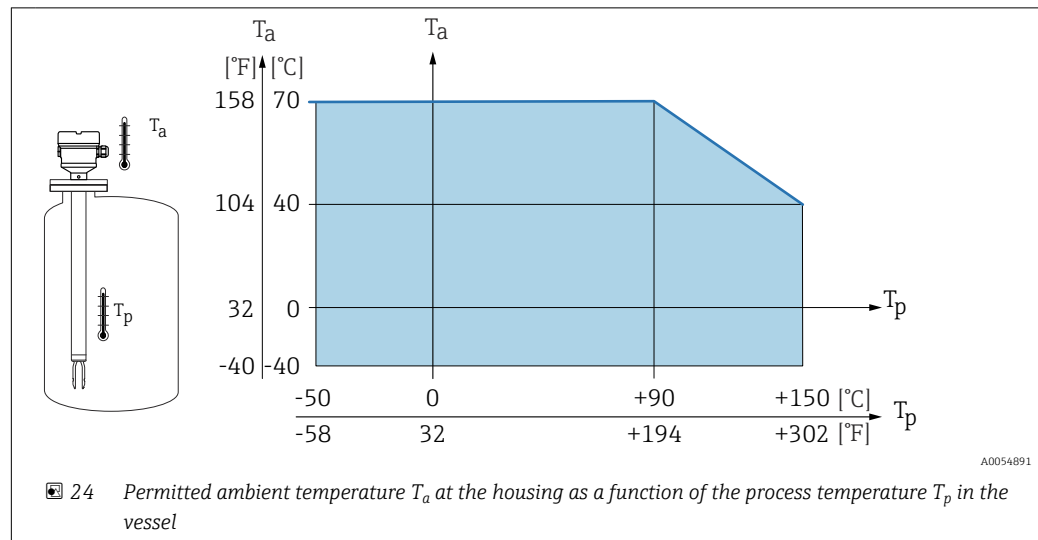

Hazardous area

In the hazardous area, the permitted ambient temperature can be limited depending on the zones and gas groups. Pay attention to the information in the Ex documentation (XA).


Storage temperature	-40 to +80 °C (-40 to +176 °F) Optionally in combination with HART: -50 °C (-58 °F) or -60 °C (-76 °F)
Operating height	Up to 5 000 m (16 404 ft) above sea level.
Climate class	As per IEC 60068-2-38 test Z/AD
Degree of protection	Testing according to IEC 60529 and NEMA 250 IP68 test condition: 1.83 m H ₂ O for 24 h Housing See cable entries Cable entries ■ M20 coupling, plastic, IP66/68 NEMA Type 4X/6P ■ M20 coupling, nickel-plated brass, IP66/68 NEMA Type 4X/6P ■ M20 coupling, 316L, IP66/68 NEMA Type 4X/6P ■ M20 coupling, 316L, hygienic, IP66/68/69 NEMA Type 4X/6P ■ M20 thread, IP66/68 NEMA Type 4X/6P ■ G ½ thread, NPT ½, IP66/68 NEMA Type 4X/6P Degree of protection for M12 plug ■ When housing is closed and connecting cable is plugged in: IP66/67 NEMA Type 4X ■ When housing is open or connecting cable is not plugged in: IP20, NEMA Type 1
NOTICE M12 plug: Loss of IP protection class due to incorrect installation! ▶ The degree of protection only applies if the connecting cable used is plugged in and screwed tight. ▶ The degree of protection only applies if the connecting cable used is specified according to IP67 NEMA Type 4X.	
i If the "M12 plug" option is selected as the electrical connection, IP66/67 NEMA Type 4X applies for all housing types.	
Vibration resistance	As per IEC 60068-2-64-2008 a(RMS) = 50 m/s ² , f = 5 to 2 000 Hz, t = 3 axes x 2 h

Shock resistance	As per IEC 60068-2-27-2008: $300 \text{ m/s}^2 [= 30 g_n] + 18 \text{ ms}$ g_n : standard acceleration of gravity
Mechanical load	Support the device in the event of severe dynamic load. Maximum lateral loading capacity of the pipe extensions and sensors: 75 Nm (55 lbf ft).  For more details, see the "Supporting the device" section.
Pollution degree	Pollution level 2
Electromagnetic compatibility (EMC)	■ Electromagnetic compatibility as per the EN 61326 series and NAMUR recommendation EMC (NE 21) Interference immunity according to Table 2 (Industrial), interference radiation according to Group 1 Class B ■ HART: ■ Fulfills the functional safety requirements (SIL) in accordance with EN 61326-3-1-x ■ Maximum deviation under disturbance: < 0.5% of span ■ PROFINET over Ethernet-APL: Maximum deviation during EMC testing: < 0.5% of the current digital measured value  For more details, refer to the EU Declaration of Conformity.

Process

Process temperature range	–50 to +150 °C (–58 to +302 °F) Observe pressure and temperature dependency,  see the "Process pressure range of the sensors" section.
Thermal shock	≤ 120 K/s
Process pressure range	–1 to +64 bar (–14.5 to 928 psi) for a maximum of 150 °C (302 °F)  The maximum pressure for the device depends on the lowest-rated element with regard to pressure. Components are: process connection, optional mounting parts, or accessories.  WARNING Incorrect design or use of the device may lead to bursting parts! This may result in severe, possibly irreversible injury to persons and environmental hazards. ▶ Only operate the device within the specified limits for the components! ▶ MWP (maximum working pressure): The maximum working pressure is specified on the nameplate. This value refers to a reference temperature of +20 °C (+68 °F) and may be applied to the device for an unlimited time. Observe the temperature dependency of the maximum working pressure. For higher temperatures, refer to the following standards for the permitted pressure values for flanges: EN 1092-1 (materials 1.4435 and 1.4404 are identical with regard to their stability/temperature property and are grouped together in under 13E0 in EN 1092-1 Tab. 18; the chemical composition of the two materials can be identical), ASME B 16.5a, JIS B 2220 (the latest version of the standard applies in each case). ▶ The Pressure Equipment Directive (2014/68/EU) uses the abbreviation "PS". The abbreviation "PS" corresponds to the maximum working pressure of the device. ▶ MWP data that deviate from this are provided in the relevant sections of the Technical Information.

Process pressure range of the sensors

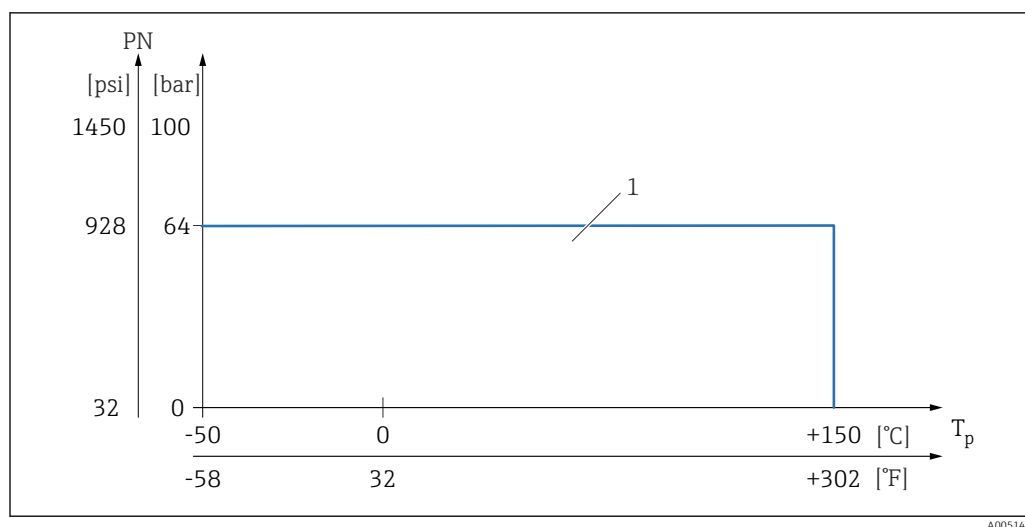

Overpressure limit

- PN = 64 bar (928 psi): overpressure limit = $1.5 \cdot \text{PN}$ maximum 100 bar (1 450 psi) depending on the selected process connection
- Membrane burst pressure at 200 bar (2 900 psi)

The device function is limited during the pressure test.

Mechanical integrity is guaranteed up to 1.5 times the process nominal pressure PN.

Medium density

Liquids with density > 0.7 g/cm³ (43.7 lb/ft³)

Setting > 0.7 g/cm³ (43.7 lb/ft³), as supplied to the customer

Liquids with density 0.5 g/cm³ (31.2 lb/ft³)

Setting > 0.5 g/cm³ (31.2 lb/ft³), can be ordered as preset value or configurable

Liquids with density > 0.4 g/cm³ (25.0 lb/ft³)

- Setting > 0.4 g/cm³ (25.0 lb/ft³), can be ordered as preset value or configurable
- Functional safety (SIL) for defined media and process parameters on request (only in combination with HART)

Viscosity

≤ 10 000 mPa·s

Pressure tightness

Up to vacuum



In vacuum evaporation plants, select the 0.4 g/cm³ (25.0 lb/ft³) / density setting.

Solids contents

Ø ≤ 5 mm (0.2 in)

Mechanical construction

Design, dimensions


Device height

The device height consists of the following components:

- Housing including cover
- Temperature spacer and/or pressure-tight feedthrough (second line of defense), optional
- Compact version, pipe extension or short pipe version
- Process connection

The individual heights of the components can be found in the following sections:

- Determine the height of the device and add the individual heights
- Take the installation clearance into consideration (space that is needed to install the device)

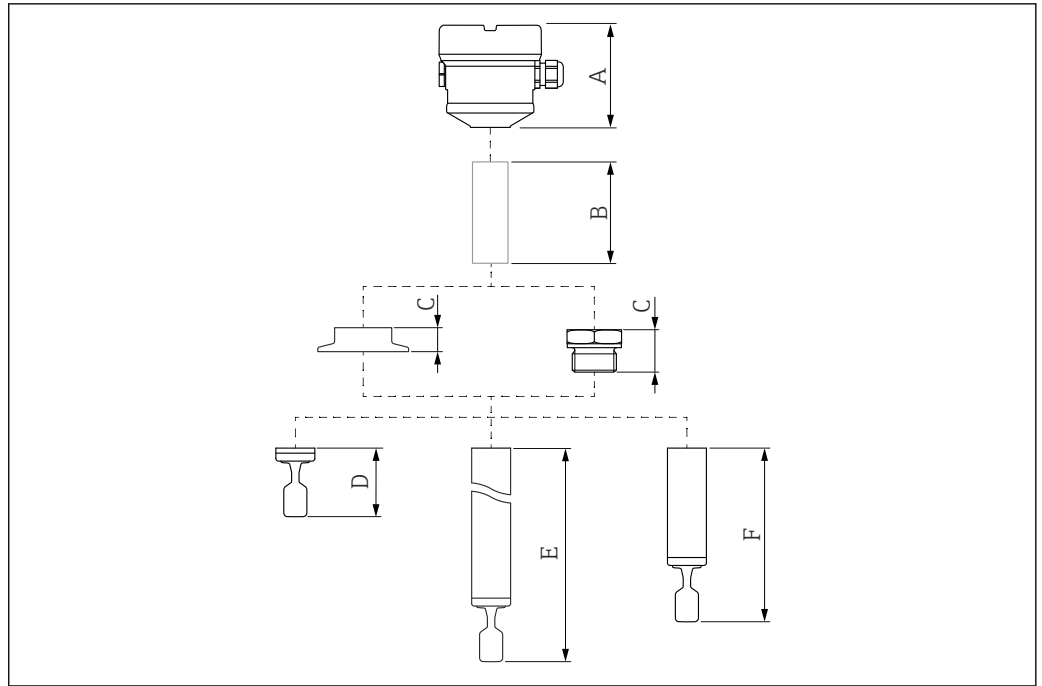

A0052410

25 Components to determine the device height

- A Housing including cover
- B Temperature spacer, pressure-tight feedthrough (optional)
- C Process connection
- D Probe design: compact version with tuning fork
- E Probe design: pipe extension with tuning fork
- F Probe design: short pipe version with tuning fork

Dimensions



The following dimensions are rounded values. As a result, there may be deviations from the specifications in the Product Configurator at www.endress.com.


To view CAD data:

1. Enter www.endress.com in your web browser
2. Search for the device
3. Select the **Configuration** button
4. Configure the device
5. Select the **CAD drawings** button

Housing and cover

All housings can be aligned. The housing alignment can be fixed on housings with a locking screw.

Single compartment housing, plastic

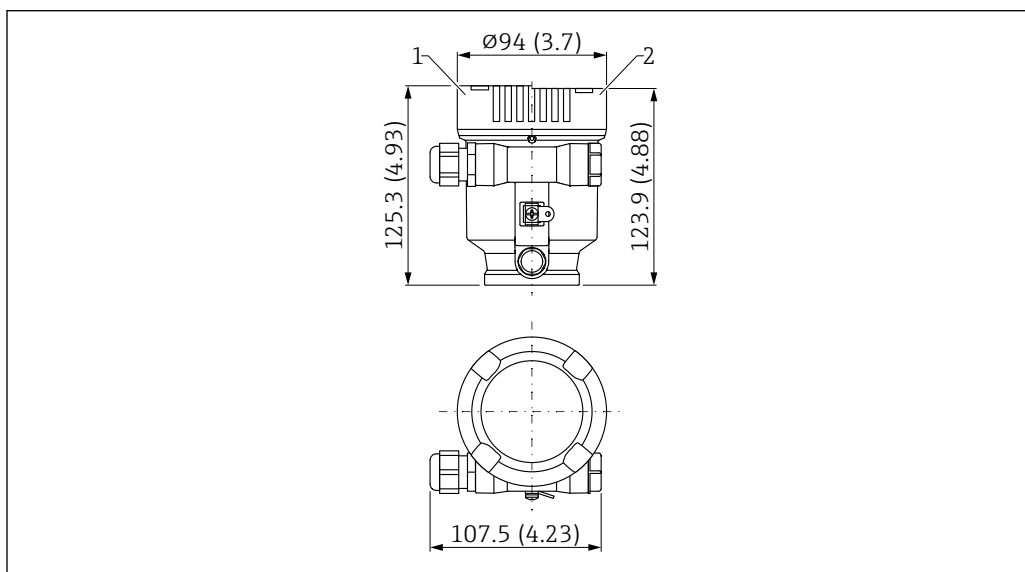


A0048768

26 Dimensions; single compartment housing, plastic; incl. M20 coupling and plug, plastic. Unit of measurement mm (in)

- 1 Height with cover comprising plastic sight glass
- 2 Height with cover without sight glass

Single-compartment housing, aluminum, coated

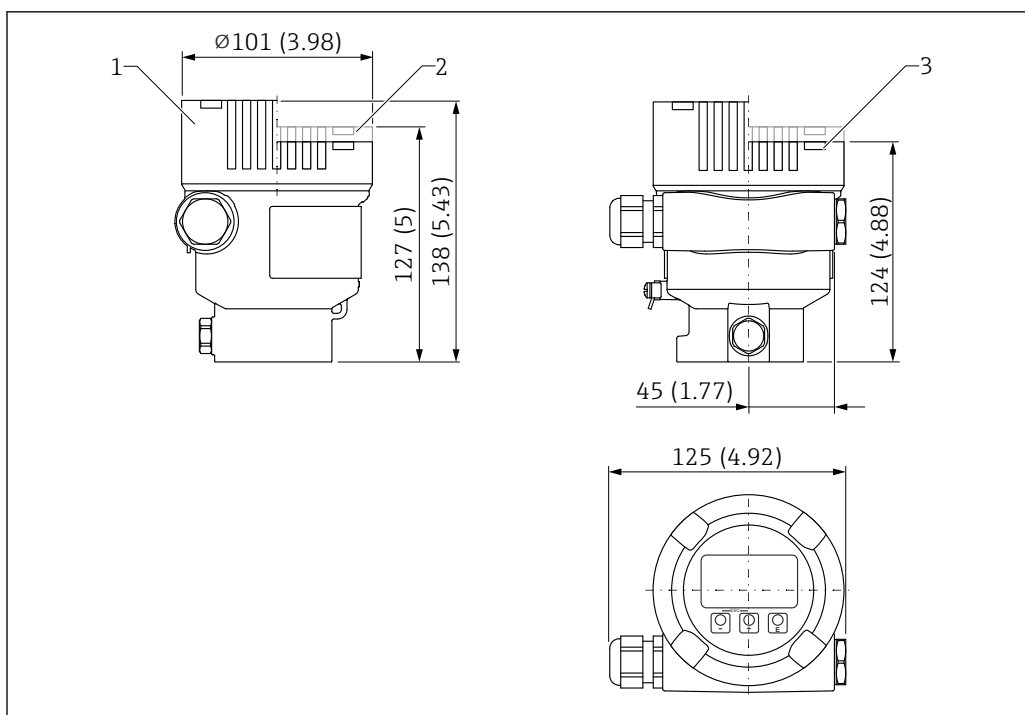

A0051701


27 Dimensions of single-compartment housing, aluminium, coated. Unit of measurement mm (in)

- 1 Height with cover comprising glass sight glass (devices for Ex d/XP, dust Ex)
- 2 Height with cover comprising plastic sight glass
- 3 Height with cover without sight glass

Single compartment housing, 316L, hygiene



For use in hazardous areas with a certain type of protection, the ground terminal on the outside of the housing is required.

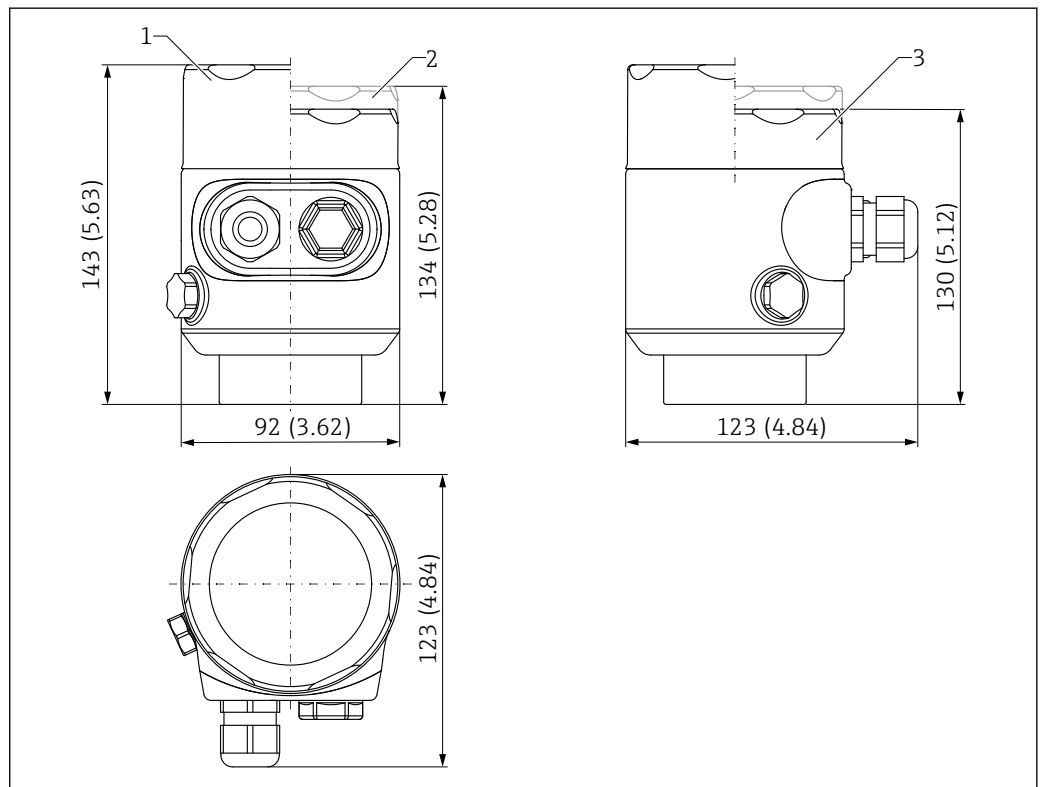


A0051702

 28 Dimensions of single compartment housing, 316 L, hygienic. Unit of measurement mm (in)

- 1 Height with cover comprising glass sight glass
- 2 Height with cover comprising plastic sight glass
- 3 Height with cover without sight glass

Dual-compartment housing, L-form, aluminum, coated

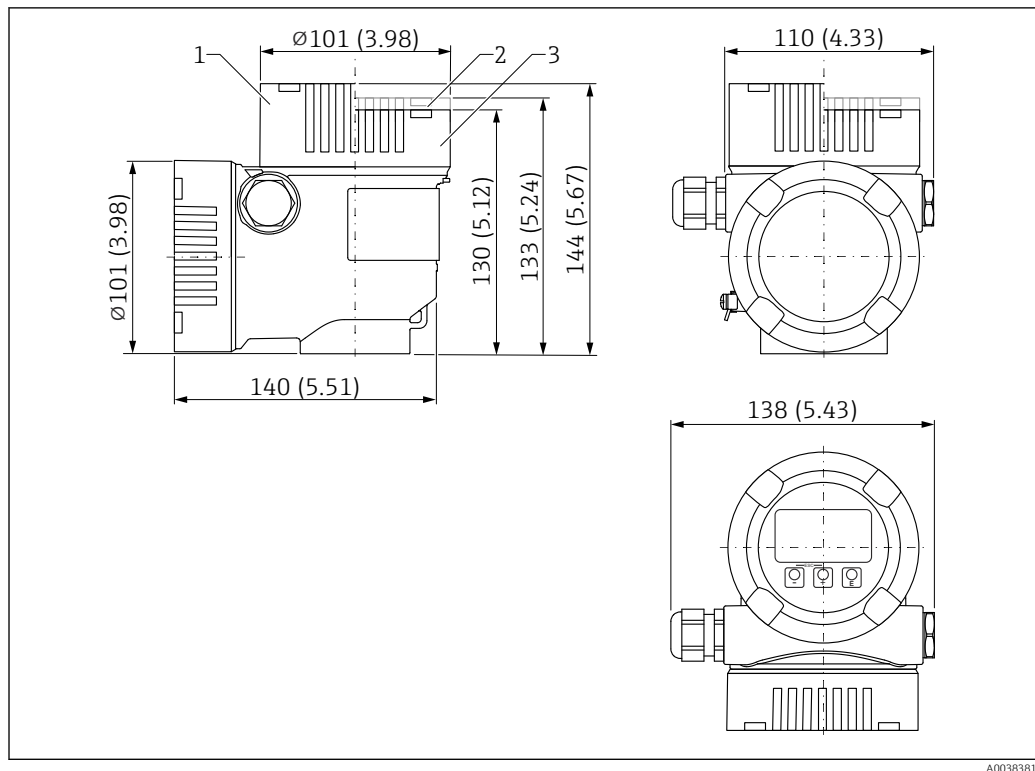


A0038381

29 Dimensions of dual-compartment housing, L-form, aluminum, coated. Unit of measurement mm (in)

- 1 Height for cover with glass sight glass (devices for Ex d/XP, dust Ex)
- 2 Height for cover with plastic sight glass
- 3 Height with cover without sight glass

Temperature spacer, pressure-tight feedthrough (optional)

Provides sealed insulation for the vessel and a normal ambient temperature for the housing.

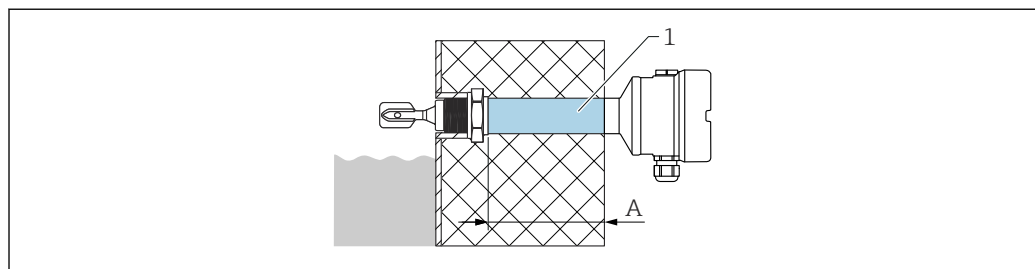

A0036845

- 1 Temperature spacer and/or pressure-tight feedthrough with maximum insulation length
- A Approx. 140 mm (5.51 in)

i Dimension A depends on the process connection selected and can therefore vary. For exact dimensions, information is available from the Endress+Hauser sales office.

Product Configurator, feature "Sensor design":


- Temperature spacer
 - Pressure-tight feedthrough (second line of defense)
- If the sensor is damaged, this protects the housing from vessel pressures up to 100 bar (1 450 psi).

i Both versions cannot be ordered in combination with Ex d approval.

i The "Pressure-tight feedthrough" version can only be selected in conjunction with the "Temperature spacer" option.

Ex d glass feedthrough for pipe extensions

If a pipe extension is required in combination with an Ex d approval, the following design is used:

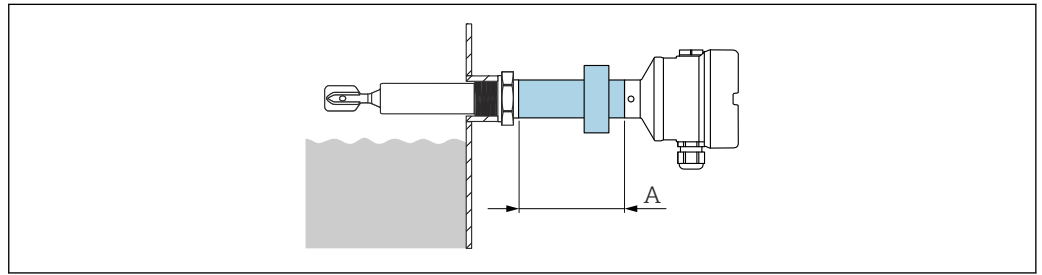

A0046136

30 Ex d glass feedthrough for pipe extensions

A Approx. 76 mm (2.99 in)


i Dimension A depends on the process connection selected and can therefore vary. For exact dimensions, information is available from the Endress+Hauser sales office.

Probe design

Compact version

Sensor length L: depends on process connection

 For more details, see the "Process connections" section.

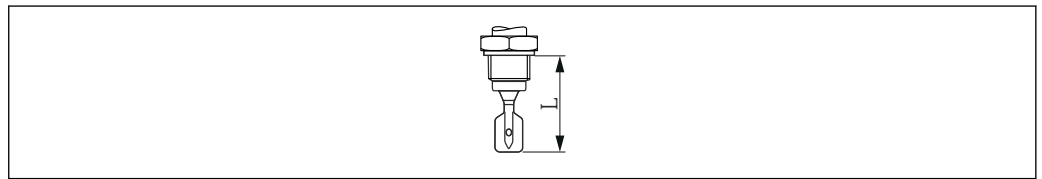

A0042435

31 Probe design: Compact version, sensor length L


Short pipe version

Sensor length L: depends on process connection

- Thread G 1 approx. 118 mm (4.65 in)
- Ingold, flush-mounted tank connection, DIN11851 pipe union, Varivent, Clamp/Tri-Clamp approx. 115 mm (4.53 in)
- Flush-mounted 1" (G 1 welding boss from Endress+Hauser) approx. 104 mm (4.09 in)

Pipe extension

- Sensor lengths L: 148 to 3 000 mm (5.83 to 118.11 in) in
- Length tolerances L: < 1 m (3.3 ft) = -5 mm (-0.2 in), 1 to 3 m (3.3 to 9.8 ft) = -10 mm (-0.39 in)

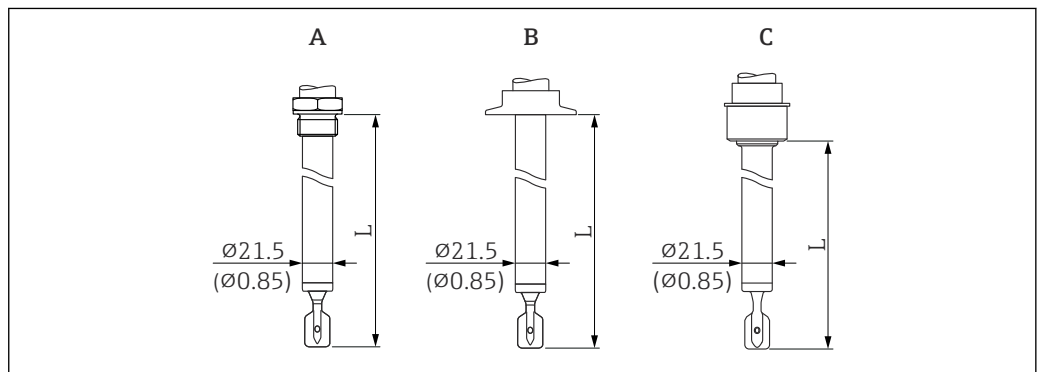

A0051989


32 Probe designs: pipe extension, short pipe (sensor length L). Unit of measurement mm (in)

A Thread G 1

B For example, clamp/Tri-Clamp, Varivent

C Flush-mounted tank connection for installation in weld-in adapter

Tuning fork

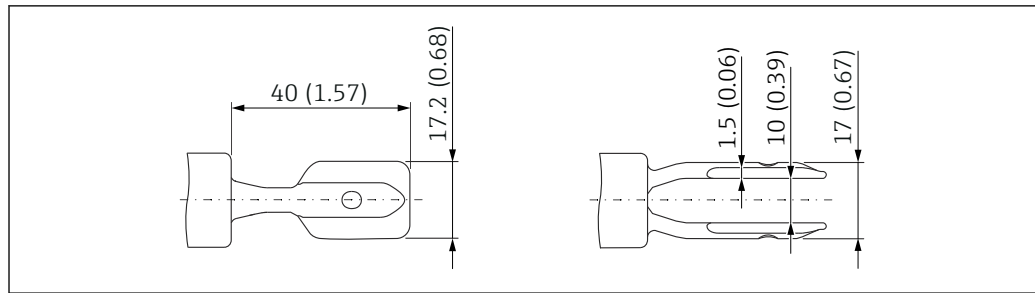

A0038269


33 Tuning fork. Unit of measurement mm (in)

Process connections

Process connection, sealing surface

- Thread ISO228, G
- Ingold
- Flush-mounted tank connection
- DIN11851 pipe union
- Varivent (Varinline)
- Clamp/Tri-Clamp

Height of process connection

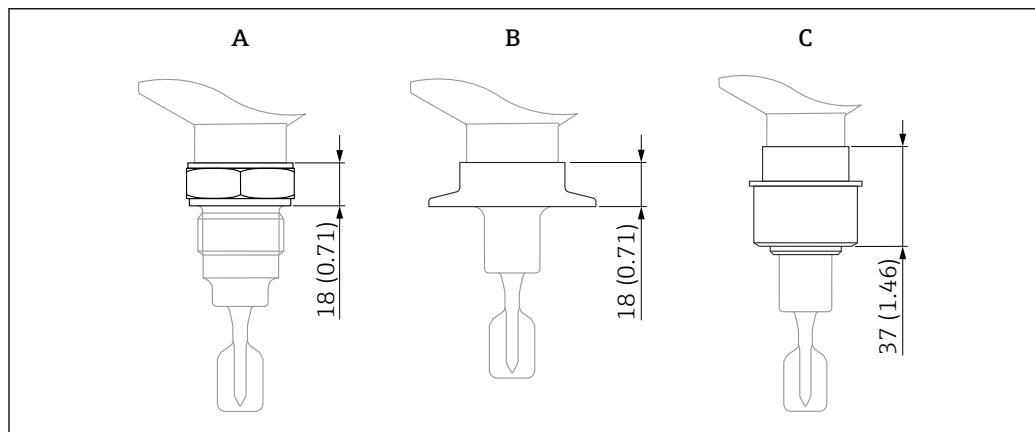

A0052399

34 Maximum height specification for the process connections. Unit of measurement mm (in)

- A Process connection with threaded connection
 B For example: Clamp/Tri-Clamp, Varivent
 C Flush-mounted tank connection for installation in welding neck


Thread ISO228 G 3/4 for installation in weld-in adapter

G 3/4 with defined thread start for flush mounting in weld-in adapter

- Only for sensor design: compact version
- Pressure rating, temperature: ≤ 40 bar (580 psi), ≤ +100 °C (+212 °F)
- Pressure rating, temperature: ≤ 25 bar (363 psi), ≤ +150 °C (+302 °F)
- Weight: 0.2 kg (0.44 lb)
- Accessories: weld-in adapter, optionally available as "Accessory enclosed"



A seal is not included in the delivery. The maximum temperature and maximum pressure depend on the clamping ring and sealing element used (according to the process connection design). The lowest value applies in each case.

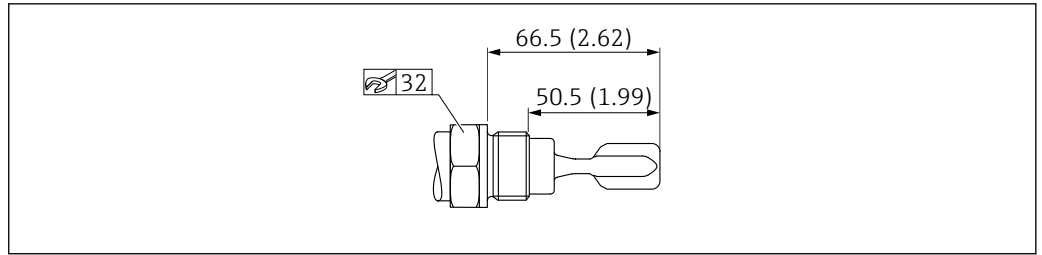

A0035549

35 Thread ISO228 G 3/4. Unit of measurement mm (in)


Thread ISO228 G 1 for installation in weld-in adapter

G 1 with defined thread start, comprising sealing surface for flush mounting in weld-in adapter

- Pressure rating, temperature: ≤ 40 bar (580 psi), ≤ +100 °C (+212 °F)
- Pressure rating, temperature: ≤ 25 bar (363 psi), ≤ +150 °C (+302 °F)
- Weight: 0.33 kg (0.73 lb)
- Accessories: weld-in adapter, optionally available as "Accessory enclosed"



A seal is not included in the delivery. The maximum temperature and maximum pressure depend on the clamping ring and sealing element used (according to the process connection design). The lowest value applies in each case.

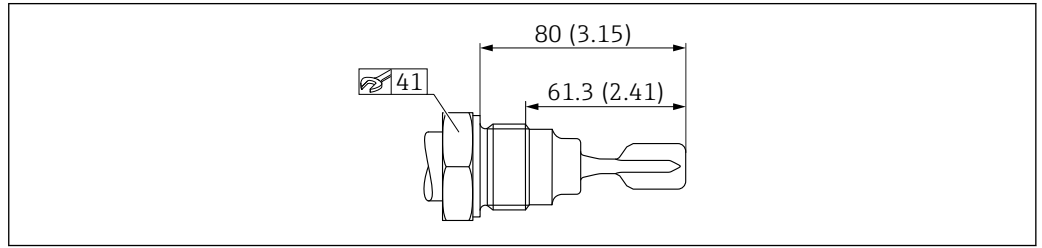


A0035551

36 Thread ISO228 G 1. Unit of measurement mm (in)

Ingold fitting

Ingold fitting 25 x 46 mm (2.52 in)

- Pressure rating: ≤ 16 bar (232 psi)
- Temperature: ≤ 150 °C (302 °F)
- Weight: 0.2 kg (0.44 lb)
- Scope of delivery: cap-nut G 1 1/4, seal

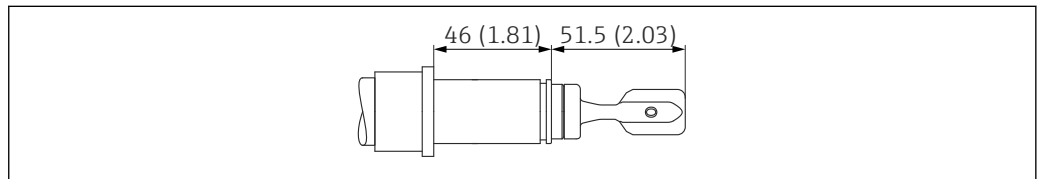


A0051991

37 Ingold fitting 25 x 46 mm (2.52 in). Unit of measurement mm (in)

Flush-mounted tank connection for installation in weld-in adapter

- Pressure rating, temperature: ≤ 40 bar (580 psi), ≤ +100 °C (+212 °F)
- Pressure rating, temperature: ≤ 25 bar (363 psi), ≤ 140 °C (284 °F)
- Weight: 0.44 kg (0.97 lb)
- Accessories: weld-in adapter, optionally available as "Accessory enclosed"
- Scope of delivery: cap-nut, seal

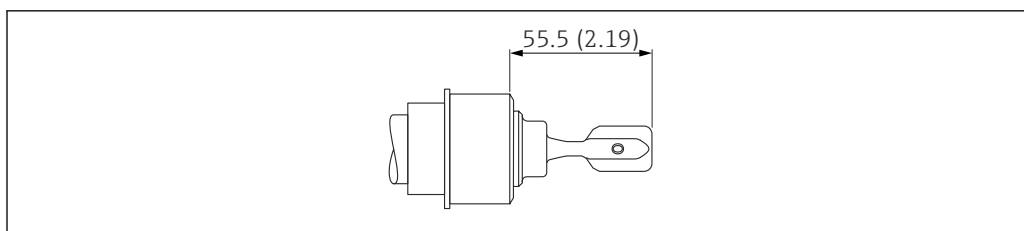

A0051993

38 Flush-mounted tank connection. Unit of measurement mm (in)

DIN11851 pipe union


DN32 PN25

- Slotted nut
- Pressure rating, temperature: ≤ 40 bar (580 psi), $\leq +100$ °C (+212 °F)
- Pressure rating, temperature: ≤ 25 bar (363 psi), ≤ 140 °C (284 °F)
- Weight: 0.3 kg (0.66 lb)

DN40 PN25

- Material: 316L
- Slotted nut
- Pressure rating, temperature: ≤ 40 bar (580 psi), $\leq +100$ °C (+212 °F)
- Pressure rating, temperature: ≤ 25 bar (363 psi), ≤ 140 °C (284 °F)
- Weight: 0.35 kg (0.77 lb)

i A seal is not included in the delivery. The maximum temperature and maximum pressure depend on the clamping ring and sealing element used (according to the process connection design). The lowest value applies in each case.

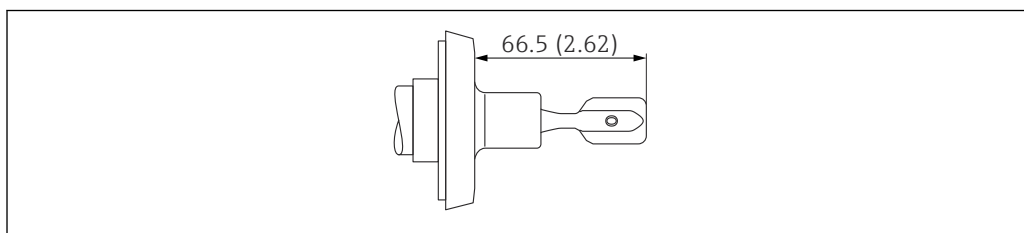

A0051995


39 DIN11851 pipe union. Unit of measurement mm (in)

Varivent (Varinline)

Varivent N pipe DN65-162 PN25

- Pressure rating: ≤ 25 bar (363 psi)
- Temperature: ≤ 150 °C (302 °F)
- Suitable for GEA Tuchenhausen
- Weight: 0.72 kg (1.59 lb)

i A seal is not included in the delivery. The maximum temperature and maximum pressure depend on the clamping ring and sealing element used (according to the process connection design). The lowest value applies in each case.

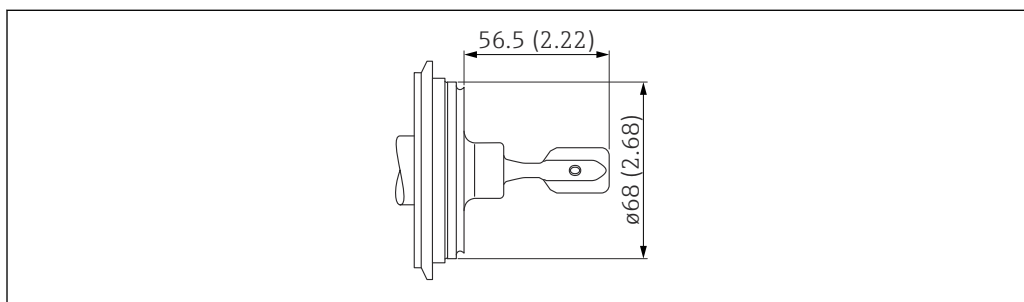

A0051996

40 Varivent N pipe DN65-162 PN25. Unit of measurement mm (in)

Tri-Clamp

ISO2852 DN25-38 (1 to 1 ½"), DIN32676 DN25-40


- Pressure rating: ≤ 25 bar (363 psi)
- Temperature: ≤ 150 °C (302 °F)
- Weight: 0.3 kg (0.66 lb)

ISO2852 DN40-51 (2"), DIN32676 DN50

- Pressure rating: ≤ 25 bar (363 psi)
- Temperature: ≤ 150 °C (302 °F)
- Weight: 0.3 kg (0.66 lb)

 The Tri-Clamp connection is NA Connect-compatible.

 A seal is not included in the delivery. The maximum temperature and maximum pressure depend on the clamping ring and sealing element used (according to the process connection design). The lowest value applies in each case.

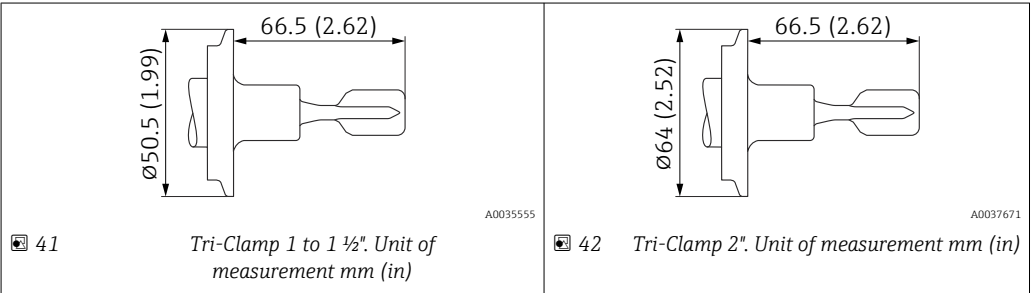

Weight

Housing

Weight including electronics and display (graphic display) without cover:

Single compartment housing

- Plastic: 0.5 kg (1.10 lb)
- Aluminum, coated: 1.2 kg (2.65 lb)
- 316L, hygiene: 1.2 kg (2.65 lb)

Dual compartment housing, L-form

Aluminum, coated: 1.7 kg (3.75 lb)

Temperature spacer

0.6 kg (1.32 lb)

Pressure-tight feedthrough

0.7 kg (1.54 lb)

Ex d glass feedthrough

0.5 kg (1.10 lb)

Pipe extension

- 1000 mm: 0.9 kg (1.98 lb)
- 50 in: 1.15 kg (2.54 lb)

Process connection

See "Process connections" section

Protective cover, plastic

0.2 kg (0.44 lb)

Protective cover, 316L

0.93 kg (2.05 lb)

Materials

Materials in contact with process

Process connection and pipe extension

316L (1.4404 or 1.4435)

Tuning fork

316L (1.4435)

Seals

-  Scope of delivery including seal
 - Ingold fitting, seal material: EPDM (in compliance with FDA, USP Class VI)
 - Flush-mounted tank connection for installation in welding neck, seal material: silicone

Materials not in contact with process

Single compartment housing, plastic

- Housing: PBT/PC
- Dummy cover: PBT/PC
- Cover with sight glass: PBT/PC and PC
- Cover seal: EPDM
- Potential equalization: 316L
- Seal under potential equalization: EPDM
- Plug: PBT-GF30-FR
- Seal on plug: EPDM
- Nameplate: plastic foil
- TAG plate: plastic foil, metal or provided by the customer

-  The cable entry with material specification can be ordered via the product structure "Electrical connection".

Single-compartment housing, aluminum, coated

- Housing: EN AC 43400 aluminum (Cu max. 0.1%)
- Housing coating, cover: polyester
- EN AC 43400 aluminum cover (Cu max. 0.1%) with Lexan 943A PC sight glass
- EN AC 43400 aluminum cover (Cu max. 0.1%) with borosilicate sight glass; for Ex d/XP, dust Ex
- Dummy cover: EN AC 43400 aluminum (Cu max. 0.1%)
- Cover sealing materials: HNBR
- Cover sealing materials: FVMQ (in low temperature version only)
- Plug: PBT-GF30-FR or aluminum
- Plug sealing material: EPDM
- Nameplate: plastic foil
- TAG plate: plastic foil, stainless steel or provided by the customer

-  The cable entry with material specification can be ordered via the product structure "Electrical connection".

Single compartment housing, 316L, hygienic

- Housing: stainless steel 316 L (1.4404)
- Dummy cover: stainless steel 316 L (1.4404)
- Cover stainless steel 316 L (1.4404) with PC Lexan 943A sight glass
- Cover stainless steel 316 L (1.4404) with borosilicate sight glass; can optionally be ordered as a mounted accessory
- Cover sealing materials: VMQ
- Potential equalization: 316L
- Seal under potential equalization: EPDM
- Plug: PBT-GF30-FR or stainless steel
- Plug sealing material: EPDM
- Nameplate: stainless steel housing labeled directly
- TAG plate: plastic foil, stainless steel or provided by the customer

-  The cable entry with material specification can be ordered via the product structure "Electrical connection".

Dual-compartment housing, L-shaped, aluminum, coated

- Housing: EN AC 43400 aluminum (Cu max. 0.1%)
- Housing coating, cover: polyester
- EN AC 43400 aluminum cover (Cu max. 0.1%) with Lexan 943A PC sight glass
- EN AC 43400 aluminum cover (Cu max. 0.1%) with borosilicate sight glass; for Ex d/XP, dust Ex
- Dummy cover: EN AC 43400 aluminum (Cu max. 0.1%)
- Cover sealing materials: HNBR
- Cover sealing materials: FVMQ (in low temperature version only)
- Plug: PBT-GF30-FR or aluminum

- Plug sealing material: EPDM
- Nameplate: plastic foil
- TAG plate: plastic foil, stainless steel or provided by the customer



The cable entry with material specification can be ordered via the product structure "Electrical connection".

Wired-on nameplate

- Stainless steel
- Plastic film
- Provided by customer
- RFID tag: polyurethane potting compound

Electrical connection

Coupling M20, plastic

- Material: PA
- Seal on cable gland: EPDM
- Dummy plug: plastic

Coupling M20, nickel-plated brass

- Material: nickel-plated brass
- Seal on cable gland: EPDM
- Dummy plug: plastic

Coupling M20, 316L

- Material: 316L
- Seal on cable gland: EPDM
- Dummy plug: plastic

M20 coupling, 316 L, hygiene

- Material: 316L
- Seal on cable gland: EPDM

M20 thread

The device is supplied with M20 thread as standard.

Transport plug: LD-PE

Thread G ½

The device is supplied as standard with an M20 thread and an enclosed adapter to G ½ including documentation (aluminum housing, 316L housing, hygienic housing) or with a mounted adapter to G ½ (plastic housing).

- Adapter made of PA66-GF or aluminum or 316L (depends on housing version ordered)
- Transport plug: LD-PE

NPT ½ thread

The device is supplied as standard with an NPT ½ thread (aluminum housing, 316L housing) or with a mounted adapter to NPT ½ (plastic housing, hygienic housing).

- Adapter made of PA66-GF or 316L (depends on housing version ordered)
- Transport plug: LD-PE

M12 plug

- Material: nickel-plated CuZn or 316L (depends on housing version ordered)
- Transport cap: LD-PE

Surface roughness

Surface roughness of the surface in contact with the process:

Ra < 1.5 µm (59 µin), CoC ASME BPE

Optional:

- Ra < 0.3 µm (12 µin) mechanically polished (3-A, EHEDG)
- Ra < 0.38 µm (15 µin) electropolished (3-A, EHEDG, CoC ASME BPE)

In this version, the parts in contact with the process are made of 316L (1.4435) in accordance with BN2 (delta ferrite content > 1 %

Operability

Operation concept

Operator-oriented menu structure for user-specific tasks

- Guidance
- Diagnostics
- Application
- System

Fast and safe commissioning

- Interactive wizard with graphical user interface for guided commissioning in FieldCare, DeviceCare or DTM, AMS and PDM-based third-party tools or SmartBlue
- Menu guidance with brief descriptions of the individual parameter functions
- Standardized operation at the device and in the operating tools
- PROFINET over Ethernet-APL: access to the device via web server

Integrated HistoROM data memory

- Adoption of data configuration when electronics modules are replaced
- Up to 100 event messages recorded in the device

Efficient diagnostic behavior increases measurement reliability

- Remedial action is integrated in plain text
- Diverse simulation options

Bluetooth® wireless technology (optionally integrated in local display)

- Quick and easy setup with SmartBlue app or PC with DeviceCare, version 1.07.05 and higher, or Field Xpert SMT70
- No additional tools or adapters required
- Encrypted single point-to-point data transmission (tested by Fraunhofer Institute) and password-protected communication via Bluetooth® wireless technology

Languages


The operating language of the local display (optional) can be selected via the Product Configurator.

If no particular operating language has been selected, the local display is delivered from the factory with English.

The operating language can be changed subsequently via the **Language** parameter.

Local operation

FEL60H electronic insert - HART

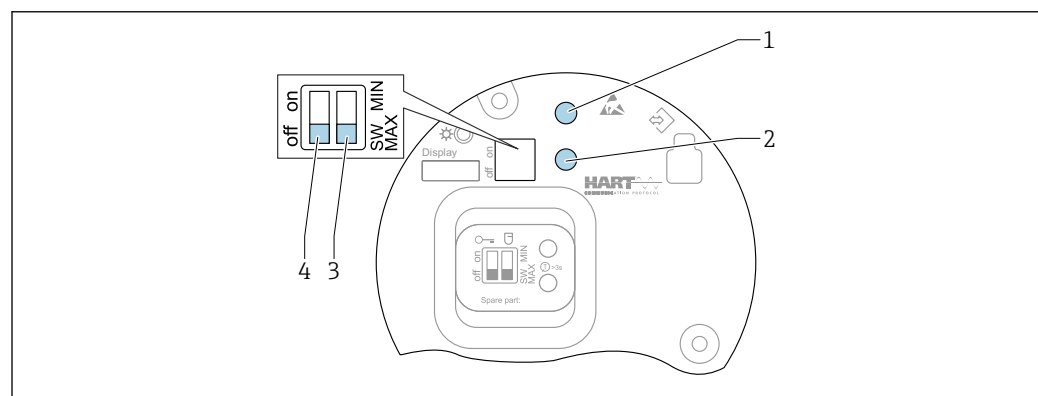

43 Operating keys and DIP switch on FEL60H electronic insert

- 1 Operating key for reset password
- 1+2 Operating keys for device reset (as-delivered state)
- 2 Operating key for Proof test
- 3 DIP switch for safety function
- 4 DIP switch for locking and unlocking the device

1: Operating key for reset password:

- For login via Bluetooth® wireless technology
- For Maintenance user role

1 + 2: Operating keys for resetting the device:

- Reset the device to the order configuration
- Press both keys 1 + 2 simultaneously

2: Operating key for Proof test:

- The output changes from the OK status to demand mode
- Press the key for > 3 s

3: DIP switch for safety function:

- SW: When the switch is set to "SW", the MIN or MAX setting is defined by the software (MAX = default value)
- MIN: In the MIN switch position, the value is permanently set to MIN irrespective of the software

4: Overview of the operating keys and DIP switch functions:

- Switch position on: Device locked
- Switch position off: Device unlocked


The minimum detection and maximum detection operating modes can be switched directly on the electronic insert:

- MIN (minimum detection): when the vibrating fork is uncovered, the output switches to demand mode, e.g. use to prevent pumps from running dry
- MAX (maximum detection): when the vibrating fork is covered, the output switches to demand mode, e.g. use as overfill protection system

i The setting of the DIP switches on the electronic insert has priority over the settings made via other operation methods (e.g. FieldCare/DeviceCare).

i Density switchover: A density preset can be ordered as an option or configured via the display, Bluetooth® wireless technology and HART.

Electronic insert (FEL60P) - Ethernet-APL

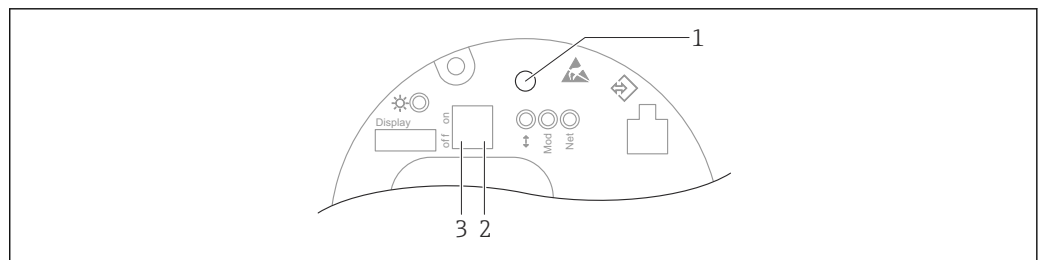

A0046061

44 Operating key and DIP switches on the electronic insert (FEL60P) - Ethernet-APL

- 1 Operating key for Reset password and Reset device
- 2 DIP switch for setting the service IP address
- 3 DIP switch for locking and unlocking the device


i The setting of the DIP switches on the electronic insert has priority over the settings made via other operation methods (e.g. FieldCare/DeviceCare).

Local display

Device display (optional)

Functions:

- Display measured values along with fault and notice messages
- Background lighting, which switches from green to red in the event of an error
- The device display can be removed for easier operation

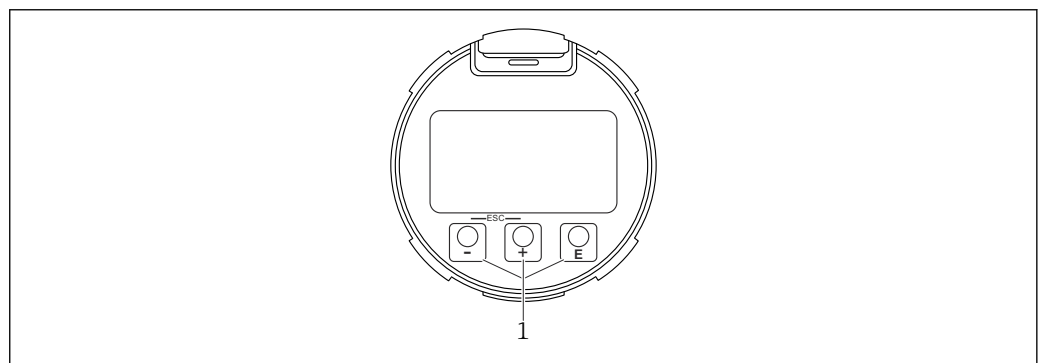


A0039284

45 Graphic display with optical operating keys (1)

Remote operation

Via HART protocol or Bluetooth® wireless technology

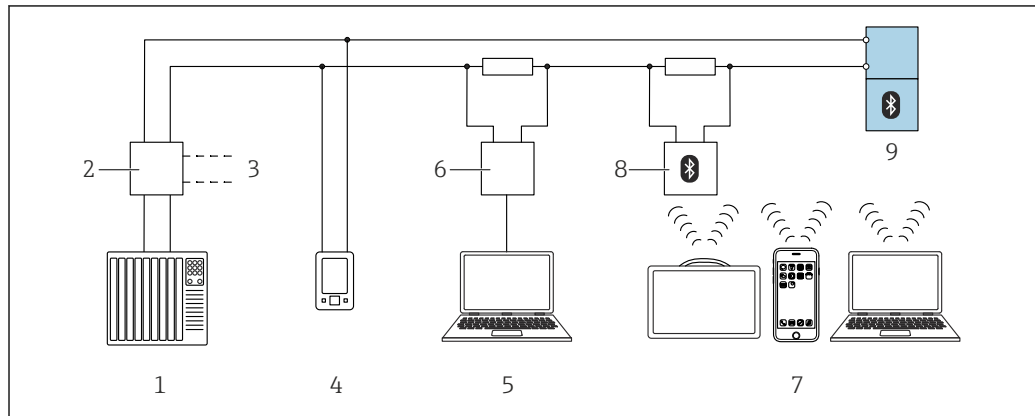


A0044334

46 Options for remote operation via HART protocol

- 1 PLC (programmable logic controller)
- 2 Transmitter power supply unit, e.g. RN42 (with communication resistor)
- 3 Connection for Commubox FXA195 and AMS Trex™ device communicator
- 4 AMS Trex™ device communicator
- 5 Computer with operating tool (e.g. DeviceCare/FieldCare, AMS Device View, SIMATIC PDM)
- 6 Commubox FXA195 (USB)
- 7 Field Xpert SMT70/SMT77, smartphone or computer with operating tool (e.g. DeviceCare)
- 8 Bluetooth® modem with connecting cable (e.g. VIATOR)
- 9 Transmitter

Via PROFINET over Ethernet-APL network

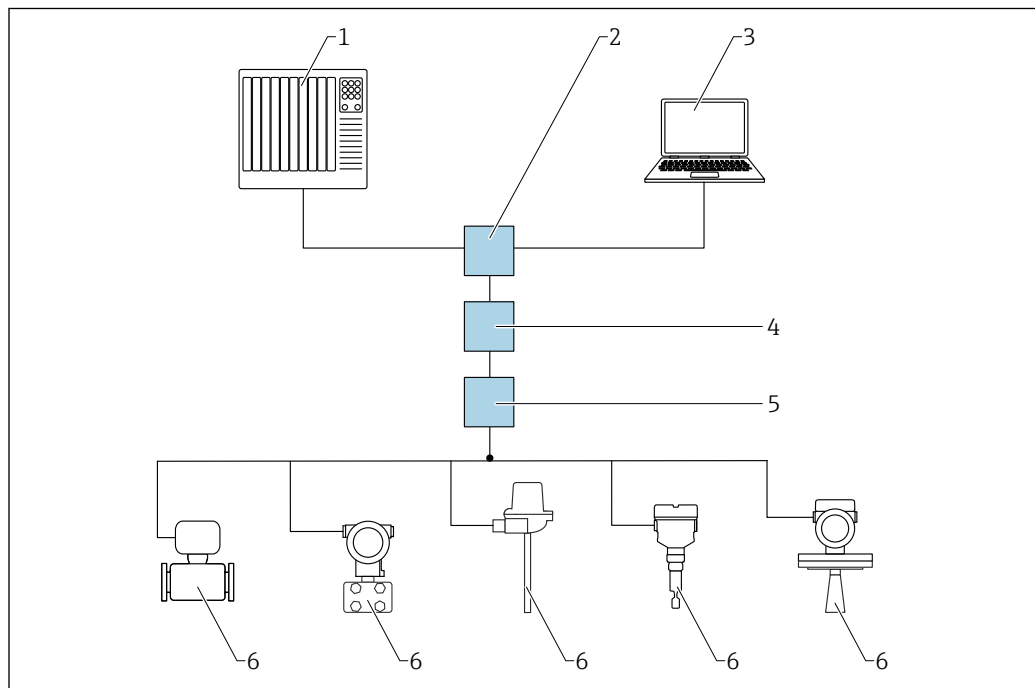

A0046097

47 Options for remote operation via PROFINET over Ethernet-APL network: star topology

- 1 Automation system, e.g. Simatic S7 (Siemens)
- 2 Ethernet switch
- 3 Computer with web browser (e.g., Microsoft Edge) for accessing the integrated device web server or computer with operating tool (e.g. FieldCare, DeviceCare, SIMATIC PDM) with iDTM PROFINET Communication
- 4 APL power switch (optional)
- 5 APL field switch
- 6 APL field device

Call up the website via the computer in the network. The IP address of the device must be known.

The IP address can be assigned to the device in a variety of ways:

- Dynamic Configuration Protocol (DCP), factory setting
The IP address is automatically assigned to the device by the automation system (e.g. Siemens S7)
 - Software addressing
The IP address is entered via the **IP address** parameter
 - DIP switch for service
The device then has the fixed assigned IP address IP address 192.168.1.212
-  The IP address is only adopted after a restart.
The IP address can now be used to establish the network connection


The default setting is that the device uses the Dynamic Configuration Protocol (DCP). The device's IP address is automatically assigned by the automation system (e.g. Siemens S7).

Via Web browser (for devices with PROFINET)

Function scope

Thanks to the integrated Web server the device can be operated and configured via a Web browser. The structure of the operating menu is the same as for the local display. In addition to the measured values, device status information is also displayed and allows users to monitor the status of the device. Furthermore the device data can be managed and the network parameters can be configured.

Via service interface (CDI)

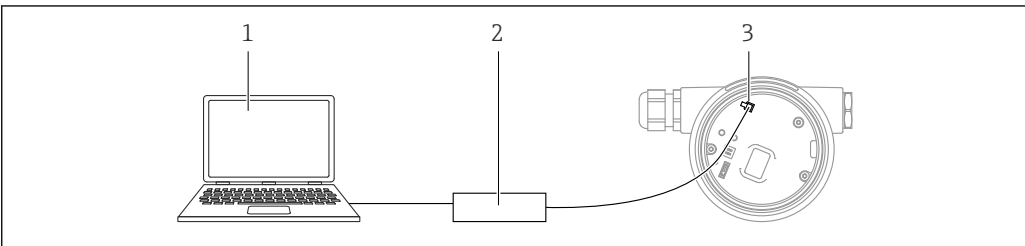

- 1 Computer with FieldCare/DeviceCare operating tool
2 Commubox
3 Service interface (CDI) of the device (= Endress+Hauser Common Data Interface)

Operation via Bluetooth® wireless technology (optional)

Prerequisite

- Measuring instrument with display including Bluetooth® wireless technology
- Smartphone or tablet with Endress+Hauser SmartBlue app or PC with DeviceCare from version 1.07.05 or FieldXpert SMT70

The connection has a range of up to 25 m (82 ft). The range can vary depending on environmental conditions such as attachments, walls or ceilings.

 The operating keys on the display are locked as soon as the device is connected via Bluetooth.

Supported operating tools	Smartphone or tablet with Endress+Hauser SmartBlue app, DeviceCare as of version 1.07.05, FieldCare, DTM, AMS and PDM. PC with Web server via fieldbus protocol.
System integration	HART Version 7 PROFINET over Ethernet-APL PROFINET Profile 4.02
HistoROM data management	When replacing the electronic insert, the stored data is transferred by reconnecting the HistoROM. The device serial number is saved in the HistoROM. The electronics serial number is saved in the electronics.

Certificates and approvals

Current certificates and approvals for the product are available at www.endress.com on the relevant product page:

1. Select the product using the filters and search field.
2. Open the product page.
3. Select **Downloads**.



The features described in this section depend on the selected product configuration.

CE mark	The measuring system meets the legal requirements of the applicable EU Directives. These are listed in the corresponding EU Declaration of Conformity together with the standards applied. Endress+Hauser confirms successful testing of the device by affixing to it the CE mark.
RCM marking	The supplied product or measuring system meets the ACMA (Australian Communications and Media Authority) requirements for network integrity, interoperability, performance characteristics as well as health and safety regulations. Here, especially the regulatory arrangements for electromagnetic compatibility are met. The products bear the RCM marking on the nameplate.  A0029561
Ex approval	All data relating to explosion protection are provided in separate Ex documentation and are available from the Downloads Area. The Ex documentation is supplied as standard with all devices approved for use in explosion hazardous areas. Explosion-protected smartphones and tablets If used in hazardous areas, mobile devices with an Ex approval must be used.
Material compliance for contact with food	The device has been developed for food contact applications. Versions can be selected that meet the following requirements: ■ EU Food Contact Material (EC) 1935/2004 ■ US Food Contact Material FDA CFR 21 ■ CN Food Contact Material GB 4806
Hygienic design compliance	3-A and EHEDG-certified versions of the sensor are suitable for Cleaning-in-Place (CIP) and Sterilization-in-Place (SIP) without removing them from the plant. This means that the sensor does not need to be removed during cleaning. The maximum permitted pressure and temperature values for sensor and adapter must not be exceeded (see notes in this TI). ■ Notes on installation and certification in accordance with 3-A and EHEDG: - SD02503F document "Hygienic approvals" ■ Information on 3-A and EHEDG-certified adapters: - TI00426F document "Weld-in adapters, process adapters and flanges"
cGMP	The device was developed for life sciences applications. You can select versions with a cGMP declaration (Current Good Manufacturing Practice) for process-wetted parts with the following content in English: ■ Materials of construction ■ Polishing and surface treatment ■ Materials and compounds compliance table: USP, FDA ■ TSE/BSE-compliant based on EMA/410/01 Rev.3
General material compliance	Endress+Hauser guarantees compliance with all relevant laws and regulations, including the current guidelines for materials and substances.

Examples:

- RoHS
- China RoHS
- REACH
- POP VO (Stockholm Convention)

For further information and general declarations of compliance, see the Endress+Hauser website www.endress.com

Overfill protection system	Before mounting the device, observe the documentation from the WHG approvals (German Federal Water Act). Approved for overfill protection systems and leakage detection.  Product Configurator: feature "Additional approval"
Functional safety	In combination with HART: The device has been developed according to the IEC 61508 standard. The device is suitable for overfill protection systems and dry-run protection up to SIL 2 (SIL 3 with homogeneous redundancy). A detailed description of the safety functions with the device, settings and functional safety data are provided in the "Functional Safety Manual" on the Endress+Hauser website: www.endress.com → Downloads.  Product Configurator: feature "Additional approval" Subsequent confirmation of usability according to IEC 61508 is not possible.
Radio approval	 Further information and currently available documentation can be found on the Endress+Hauser website: www.endress.com → Downloads.
CRN approval	Device versions with a CRN approval (Canadian Registration Number) are listed in the corresponding registration documents. CRN-approved devices are marked with a registration number. Any restrictions regarding the maximum process pressure values are listed on the CRN certificate.  Product Configurator: feature "Additional approval"
TSE (BSE) compliance (ADI free - Animal Derived Ingredients)	Versions can be selected that meet the following requirements: ■ The parts of this product in contact with the process are not made from materials derived from animals or ■ The parts of this product in contact with the process correspond to at least the requirements of the EMA/410/01 Rev. 3 guideline (TSE (BSE) compliant)
Pressure equipment with permitted pressure less than 200 bar, no pressure-bearing volume	Pressure instruments with a process connection that does not have a pressurized housing do not fall within the scope of the Pressure Equipment Directive, irrespective of the maximum working pressure. Reasons: If pressure equipment does not have a pressure-bearing housing (no identifiable pressure chamber of its own), there is no pressure accessory present within the meaning of the Directive.  Druckgeräterichtlinie DGRL (PED) 2014/68/EU, Artikel 2, Absatz 5
Process seal as per ANSI/ISA 12.27.01	North American practice for the installation of process seals. In accordance with ANSI/ISA 12.27.01, Endress+Hauser devices are designed as either single seal or dual seal devices with a warning message. This allows the user to forego the use of - and save the cost of installing - an external secondary process seal in the mating pipe as required in ANSI/NFPA 70 (NEC) and CSA 22.1 (CEC). These instruments comply with the North American installation practice and provide a very safe and cost-saving installation for pressurized applications with hazardous fluids.  Please refer to the Safety Instructions (XA) of the relevant device for further information.
EAC conformity	The measuring system meets the legal requirements of the applicable EAC guidelines. These are listed in the corresponding EAC Declaration of Conformity along with the standards applied.

The manufacturer confirms successful testing of the device by affixing to it the EAC mark.

ASME B 31.3/31.1	Design and materials in accordance with ASME B31.3/31.1. The welds are through-penetration welded and meet the requirements of the ASME Boiler and Pressure Vessel Code, Section IX and EN ISO 15614-1.
ASME BPE	The measuring system was developed for life sciences applications. Options can be selected that meet the requirements of the ASME BPE (Bioprocessing Equipment) standard.
HART certification	HART interface The measuring instrument is certified and registered by the FieldComm Group. The measuring system meets all the requirements of the following specifications: ■ Certified according to HART 7 ■ The device can also be operated with certified devices of other manufacturers (interoperability)
PROFINET over Ethernet-APL certification	PROFINET interface The device is certified and registered by the PNO (PROFIBUS Nutzerorganisation e. V.). The measuring system meets all the requirements of the following specifications: ■ Certified according to: ■ Test specification for PROFINET devices ■ PROFINET PA Profile 4.02 ■ PROFINET Netload Robustness Class 2 10 Mbit/s ■ APL conformance test ■ The device can also be operated with certified devices of other manufacturers (interoperability) ■ The device supports PROFINET S2 system redundancy.

Ordering information

Detailed ordering information is available from your nearest sales organization www.addresses.endress.com or in the Product Configurator at www.endress.com:

1. Select the product using the filters and search field.
2. Open the product page.
3. Select **Configuration**.



Product Configurator - the tool for individual product configuration

- Up-to-the-minute configuration data
- Depending on the device: direct input of information specific to the measuring point, such as the measuring range or operating language
- Automatic verification of exclusion criteria
- Automatic creation of the order code and its breakdown in PDF or Excel output format
- Ability to order directly in the Endress+Hauser Online Shop

Service	■ Cleaned of oil+grease (wetted) ■ PWIS-free (paint-wetting impairment substances) - The plastic protective cover and the weld-in adapters are excluded from the PWIS cleaning ■ Switching delay setting to be spec. ■ Setting for MIN safety mode ■ Set HART burst mode PV ■ Setting for max. alarm current ■ Default density setting > 0.4 g/cm³ (25.0 lb/ft³) ■ Default density setting > 0.5 g/cm³ (31.2 lb/ft³) ■ Bluetooth communication is disabled on delivery
----------------	--

Test reports, declarations and inspection certificates

All test reports, declarations and inspection certificates are provided electronically in the *Device Viewer*:

Enter the serial number from the nameplate

(<https://www.endress.com/de/pages/supporting-tools/device-viewer>)



Product documentation on paper

Test reports, declarations and inspection certificates in hard copy can optionally be ordered with feature 570 "Service", Version I7 "Product documentation on paper". The documents are then provided with the device upon delivery.

Test, certificate, declaration

Versions can be selected for which the following certificates are available:

- Inspection certificate 3.1, EN10204 (material certificate, wetted parts)
- AD 2000 (wetted parts), declaration, excluding cast parts
- CoC ASME BPE, declaration
- ASME B31.3 process piping, declaration
- Compliance with requirements derived from cGMP, declaration
- EU Food Contact Material (EC) 1935/2004
- US Food Contact Material FDA CFR 21
- CN Food Contact Material GB 4806
- Surface roughness test ISO4287/Ra, (wetted parts), test report
- Delta-ferrite test, internal procedure (wetted parts), test report



Documentation currently available on the Endress+Hauser website: www.endress.com → Downloads or with the serial number of the device under Online Tools in the Device Viewer.

TAG

Measuring point (TAG)

The device can be ordered with a tag name.

Location of tag name

In the additional specification, select:

- Stainless steel tag plate
- Paper adhesive label
- TAG provided by the customer
- RFID tag
- RFID tag + stainless steel tag plate
- RFID tag + paper adhesive label
- RFID tag + tag provided by the customer
- IEC 61406 stainless steel tag
- IEC 61406 stainless steel + NFC tag
- IEC 61406 stainless steel tag, stainless steel tag
- IEC 61406 stainless steel tag + NFC, stainless steel tag
- IEC 61406 stainless steel tag, plate supplied
- IEC 61406 stainless steel tag + NFC, plate supplied

Definition of tag name

In the additional specification, specify:

Three lines of maximum 18 characters each

The specified tag name appears on the selected plate and/or on the RFID tag.

Visualization in SmartBlue app

The first 32 characters of the tag name

The tag name can always be changed specifically for the measuring point via Bluetooth.

Display in electronic nameplate (ENP)

The first 32 characters of the tag name

Application packages

Heartbeat Technology

Availability:

The Heartbeat Verification + Monitoring application package is optionally available for all device versions

The application package can be ordered together with the device or can be activated subsequently with an activation code.



SD02874F: Heartbeat Verification + Monitoring application package (HART)

 SD03459F: Heartbeat Verification + Monitoring application package (PROFINET over Ethernet APL)

Heartbeat Technology module

Heartbeat Diagnostics

Continuously monitors and assesses the device condition and process conditions. Generates diagnostic messages when certain events occur and provides troubleshooting measures in accordance with NAMUR NE 107.

Heartbeat Verification

Performs a verification of the current device condition on demand and generates the Heartbeat Technology verification report showing the verification result.

Heartbeat Monitoring

Continuously provides device and/or process data for an external system. Analysis of this data provides a basis for process optimization and predictive maintenance.

Heartbeat Diagnostics	Diagnostic messages output to: ■ the local display ■ an asset management system (e.g. FieldCare or DeviceCare) ■ an automation system (e.g. PLC) ■ Web server
Heartbeat Verification	■ Verification of device status in the installed state without interrupting the process ■ Ensure measuring point reliability and documentation compliant to standards ■ Verification on demand ■ Clear measuring point analysis (Passed/Failed) ■ High total test coverage within the framework of manufacturer specifications ■ Compliance with regulatory requirements (e.g., ISO 9001:2015, Section 7.1.5.2) "Heartbeat Verification" wizard: ■ Integrated in the Heartbeat Verification module ■ Operation via SmartBlue app, DTM, display ■ Guides the user through the verification process step-by-step Information contained in the verification report: ■ Operating hours counter ■ Temperature and frequency indicator ■ Oscillation frequency in as-delivered state (in air) as reference value ■ Oscillation frequency: ■ High oscillation frequency → Reference to corrosion ■ Reduced oscillation frequency → Note on buildup or covered sensor Deviations can be affected by the process temperature or process pressure ■ Frequency history: - Storage of last 16 sensor frequencies at the time of verification
Heartbeat Monitoring	■ Process window wizard: Two frequency limits for monitoring the upper and lower range of the oscillation frequency (can be defined independently of one another). Changes in the process can be identified, e.g. corrosion or buildup. ■ In combination with HART: Loop diagnostics wizard: Detection of elevated measuring circuit resistance values or declining power supply
Proof testing (HART)	 Proof testing is only available for devices with HART communication that have a SIL or WHG (German Federal Water Act) approval. A proof test is required at appropriate intervals in the following applications: SIL (IEC 61508/IEC 61511), WHG (German Federal Water Act). The Proof test wizard is available with the ordered SIL or WHG approval. The wizard guides the user through the entire process for creating the verification report. The verification report can be saved as a PDF file.

Accessories

The accessories currently available for the product can be selected at www.endress.com:

1. Select the product using the filters and search field.
2. Open the product page.
3. Select **Spare parts & Accessories**.



The accessories can be partially ordered via the "Accessory enclosed" product structure.

Device Viewer


All the spare parts for the device, along with the order code, are listed in the *Device Viewer* (www.endress.com/deviceviewer).

Weather protection cover: 316L, XW112

The weather protection cover can be ordered together with the device via the "Accessory enclosed" product structure.

It is used to protect against direct sunlight, precipitation and ice.

Weather protection cover 316L is suitable for the dual compartment housing made of aluminum or 316L. The delivery includes the holder for direct mounting on the housing.

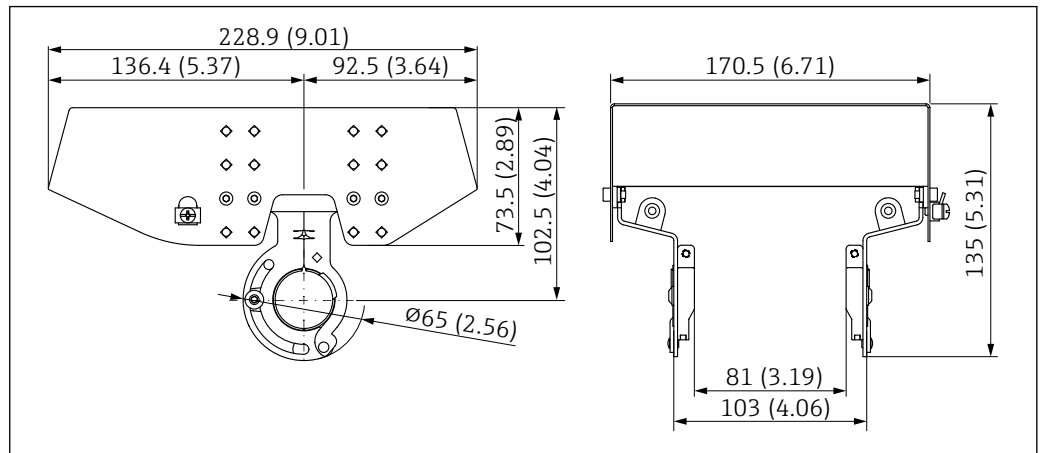

48 Dimensions of weather protection cover, 316 L, XW112. Unit of measurement mm (in)

Material

- Weather protection cover: 316L
- Clamping screw: A4
- Bracket: 316L

Accessory order code:

71438303




Special Documentation SD02424F

Weather protection cover, plastic, XW111

The weather protection cover can be ordered together with the device via the "Accessory enclosed" product structure.

It is used to protect against direct sunlight, precipitation and ice.

The plastic weather protection cover is suitable for the single compartment housing made of aluminum. The delivery includes the holder for direct mounting on the housing.

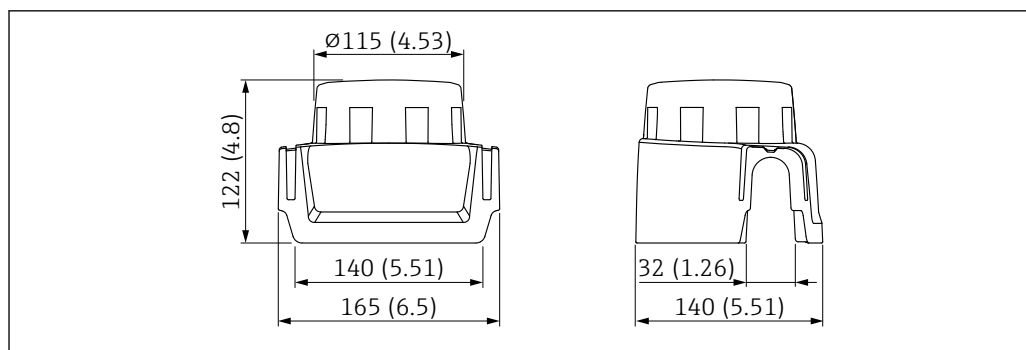

A0038280

49 Dimensions of weather protection cover, plastic, XW111. Unit of measurement mm (in)

Material

Plastic


Accessory order code:

71438291

 Special Documentation SD02423F

Weld-in adapter

Various weld-in adapters are available for installation in vessels or pipes. The adapters are optionally available with inspection certificate 3.1 EN10204.

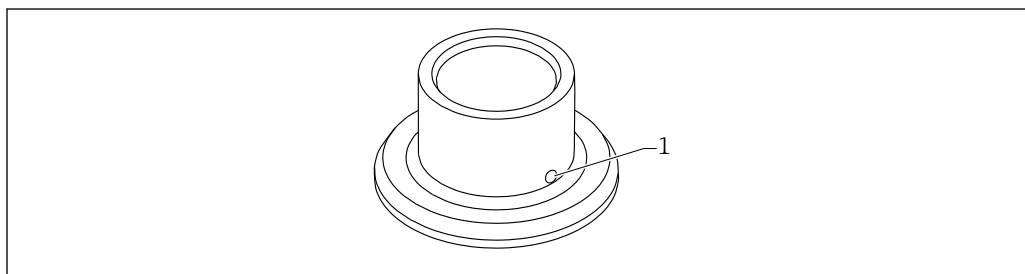

A0023557

50 Weld-in adapter with leakage hole (sample view)

1 Leakage hole

Weld in the weld-in adapter in such a way that the leakage hole is pointing downwards. This enables any leaks to be detected quickly.

- G 1, Ø53 mounting on the pipe
- G 1, Ø60 flush mount on the vessel
- G ¾, Ø55 flush mount
- G 1 sensor adjustable
- RD52 sensor adjustable

 For detailed information, see "Technical Information" TI00426F (Weld-in adapters, process adapters and flanges)

Available in the Download Area of the Endress+Hauser website
(www.endress.com/downloads).

M12 socket

 The M12 sockets listed are suitable for use in the temperature range
–25 to +70 °C (–13 to +158 °F).

M12 socket IP69

- Terminated at one end
- Angled
- 5 m (16 ft) PVC cable (orange)
- Slotted nut 316L (1.4435)
- Body: PVC
- Order number: 52024216

M12 socket IP67

- Angled
- 5 m (16 ft) PVC cable (gray)
- Slotted nut Cu Sn/Ni
- Body: PUR
- Order number: 52010285

Field Xpert SMT70

Universal, high-performance tablet PC for device configuration in Ex Zone 2 and non-Ex areas



Technical Information TI01342S

DeviceCare SFE100

Configuration tool for HART, PROFIBUS and FOUNDATION Fieldbus field devices



Technical Information TI01134S

FieldCare SFE500

FDT-based plant asset management tool

It can configure all smart field units in your system and helps you manage them. By using the status information, it is also a simple but effective way of checking their status and condition.



Technical Information TI00028S

Documentation



For an overview of the scope of the associated Technical Documentation, refer to the following:

- *Device Viewer* (www.endress.com/deviceviewer): Enter the serial number from the nameplate
- *Endress+Hauser Operations app*: Enter serial number from nameplate or scan matrix code on nameplate.

Standard documentation

Document type: Operating Instructions (BA)

Installation and initial commissioning – contains all functions in the operating menu that are required for a typical measuring task. Functions beyond this scope are not included.

Document type: Description of Device Parameters (GP)

The document is part of the Operating Instructions and serves as a reference for parameters, providing a detailed explanation of each individual parameter of the operating menu.

Document type: Brief Operating Instructions (KA)

Quick guide to the first measured value – includes all essential information from incoming acceptance to electrical connection.

Document type: Safety Instructions, certificates

Depending on the approval, Safety Instructions are supplied with the device, e.g. XA. This documentation is an integral part of the Operating Instructions.

The nameplate indicates which Safety Instructions (XA) apply to the device in question.

Supplementary device-dependent documentation

Additional documents are supplied depending on the device version ordered: Always comply strictly with the instructions in the supplementary documentation. The supplementary documentation is an integral part of the device documentation.

Special Documentation

- SD02874F: Heartbeat Verification + Monitoring application package (HART)
- SD03459F: Heartbeat Verification + Monitoring application package (PROFINET over Ethernet APL)
- SD02530P: Remote operation via Bluetooth® wireless technology (radio approval, commissioning with Bluetooth® wireless technology)
- SD01622P: Weld-in adapter (Installation Instructions)
- TI00426F: Weld-in adapters, process adapters and flanges (overview)

Registered trademarks

HART®

Registered trademark of the FieldComm Group, Austin, Texas, USA

PROFINET®

Registered trademark of the PROFIBUS User Organization, Karlsruhe, Germany

Ethernet-APL™

- Ethernet-APL ADVANCED PHYSICAL LAYER
- Registered trademark of the PROFIBUS Nutzerorganisation e.V. (Profibus User Organization), Karlsruhe - Germany

Bluetooth®

The *Bluetooth®* word mark and logos are registered trademarks owned by the Bluetooth SIG, Inc. and any use of such marks by Endress+Hauser is under license. Other trademarks and trade names are those of their respective owners.

Apple®

Apple, the Apple logo, iPhone, and iPod touch are trademarks of Apple Inc., registered in the U.S. and other countries. App Store is a service mark of Apple Inc.

Android®

Android, Google Play and the Google Play logo are trademarks of Google Inc.



71724285

www.addresses.endress.com

For more Endress+Hauser product please visit: www.ainstru.com

Mail: Sales@ainstru.com