

# Operating Instructions

Pressure sensor with ceramic measuring cell

## VEGABAR 18

Two-wire: 4 ... 20 mA



Document ID: 55575



# VEGA

## Contents

|          |                                                        |           |
|----------|--------------------------------------------------------|-----------|
| <b>1</b> | <b>About this document .....</b>                       | <b>3</b>  |
| 1.1      | Function .....                                         | 3         |
| 1.2      | Target group .....                                     | 3         |
| 1.3      | Symbols used.....                                      | 3         |
| <b>2</b> | <b>For your safety .....</b>                           | <b>4</b>  |
| 2.1      | Authorised personnel .....                             | 4         |
| 2.2      | Intended use .....                                     | 4         |
| 2.3      | Warning about incorrect use.....                       | 4         |
| 2.4      | General safety instructions .....                      | 4         |
| 2.5      | Installation and operation in the USA and Canada ..... | 4         |
| <b>3</b> | <b>Product description .....</b>                       | <b>6</b>  |
| 3.1      | Configuration.....                                     | 6         |
| 3.2      | Principle of operation.....                            | 7         |
| 3.3      | Adjustment .....                                       | 8         |
| 3.4      | Packaging, transport and storage.....                  | 8         |
| 3.5      | Accessories.....                                       | 9         |
| <b>4</b> | <b>Mounting.....</b>                                   | <b>10</b> |
| 4.1      | General instructions .....                             | 10        |
| 4.2      | Process pressure measurement.....                      | 12        |
| <b>5</b> | <b>Connecting to power supply.....</b>                 | <b>14</b> |
| 5.1      | Preparing the connection .....                         | 14        |
| 5.2      | Connection procedure.....                              | 14        |
| 5.3      | Wiring plan .....                                      | 16        |
| 5.4      | Switch-on phase.....                                   | 16        |
| <b>6</b> | <b>Diagnostics and servicing .....</b>                 | <b>17</b> |
| 6.1      | Maintenance .....                                      | 17        |
| 6.2      | Rectify faults.....                                    | 17        |
| 6.3      | Diagnosis, fault messages .....                        | 18        |
| 6.4      | How to proceed if a repair is necessary.....           | 18        |
| <b>7</b> | <b>Dismount.....</b>                                   | <b>19</b> |
| 7.1      | Dismounting steps.....                                 | 19        |
| 7.2      | Disposal .....                                         | 19        |
| <b>8</b> | <b>Certificates and approvals .....</b>                | <b>20</b> |
| 8.1      | Approvals for Ex areas .....                           | 20        |
| 8.2      | Conformity.....                                        | 20        |
| 8.3      | NAMUR recommendations .....                            | 20        |
| 8.4      | Environment management system .....                    | 20        |
| <b>9</b> | <b>Supplement .....</b>                                | <b>21</b> |
| 9.1      | Technical data .....                                   | 21        |
| 9.2      | Dimensions .....                                       | 26        |
| 9.3      | Industrial property rights.....                        | 27        |
| 9.4      | Licensing information for open source software .....   | 27        |
| 9.5      | Trademark .....                                        | 27        |

# 1 About this document

## 1.1 Function

This instruction provides all the information you need for mounting, connection and setup as well as important instructions for maintenance, fault rectification, safety and the exchange of parts. Please read this information before putting the instrument into operation and keep this manual accessible in the immediate vicinity of the device.

## 1.2 Target group

This instruction manual is directed to trained personnel. The contents of this manual must be made available to the qualified personnel and implemented.

## 1.3 Symbols used



### Document ID

This symbol on the front page of this instruction refers to the Document ID. By entering the Document ID on [www.vega.com](http://www.vega.com) you will reach the document download.



**Information, note, tip:** This symbol indicates helpful additional information and tips for successful work.



**Note:** This symbol indicates notes to prevent failures, malfunctions, damage to devices or plants.



**Caution:** Non-observance of the information marked with this symbol may result in personal injury.



**Warning:** Non-observance of the information marked with this symbol may result in serious or fatal personal injury.



**Danger:** Non-observance of the information marked with this symbol results in serious or fatal personal injury.



### Ex applications

This symbol indicates special instructions for Ex applications.



### List

The dot set in front indicates a list with no implied sequence.



### Sequence of actions

Numbers set in front indicate successive steps in a procedure.



### Disposal

This symbol indicates special instructions for disposal.

## 2 For your safety

### 2.1 Authorised personnel

All operations described in this documentation must be carried out only by trained and authorized personnel.

During work on and with the device, the required personal protective equipment must always be worn.

### 2.2 Intended use

The VEGABAR 18 is a pressure transmitter for process pressure measurement.

You can find detailed information about the area of application in chapter "*Product description*".

Operational reliability is ensured only if the instrument is properly used according to the specifications in the operating instructions manual as well as possible supplementary instructions.

### 2.3 Warning about incorrect use

Inappropriate or incorrect use of this product can give rise to application-specific hazards, e.g. vessel overfill through incorrect mounting or adjustment. Damage to property and persons or environmental contamination can result. Also, the protective characteristics of the instrument can be impaired.

### 2.4 General safety instructions

This is a state-of-the-art instrument complying with all prevailing regulations and directives. The instrument must only be operated in a technically flawless and reliable condition. The operating company is responsible for the trouble-free operation of the instrument. When measuring aggressive or corrosive media that can cause a dangerous situation if the instrument malfunctions, the operating company has to implement suitable measures to make sure the instrument is functioning properly.

The safety instructions in this operating instructions manual, the national installation standards as well as the valid safety regulations and accident prevention rules must be observed.

For safety and warranty reasons, any invasive work on the device beyond that described in the operating instructions manual may be carried out only by personnel authorised by us. Arbitrary conversions or modifications are explicitly forbidden. For safety reasons, only the accessory specified by us must be used.

To avoid any danger, the safety approval markings and safety tips on the device must also be observed.

### 2.5 Installation and operation in the USA and Canada

This information is only valid for USA and Canada. Hence the following text is only available in the English language.

Installations in the US shall comply with the relevant requirements of the National Electrical Code (NEC - NFPA 70) (USA).

Installations in Canada shall comply with the relevant requirements of the Canadian Electrical Code (CEC Part I) (Canada).

## 3 Product description

### 3.1 Configuration

#### Scope of delivery

The scope of delivery encompasses:

- VEGABAR 18 pressure transmitter
- Information sheet "*Documents and software*" with:
  - Instrument serial number
  - QR code with link for direct scanning



#### Information:

Optional instrument features are also described in this instructions. The respective scope of delivery results from the order specification.

#### Constituent parts

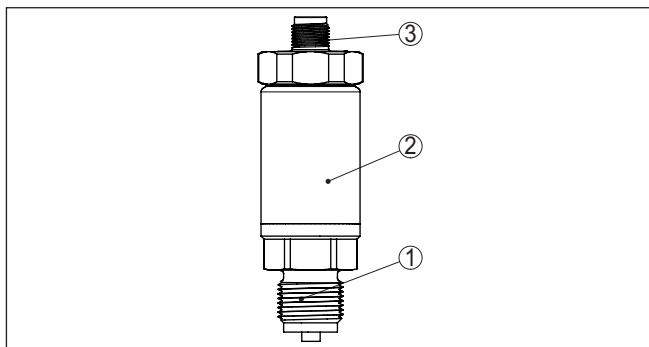


Fig. 1: Components of VEGABAR 18

- 1 Process fitting
- 2 Electronics housing
- 3 Plug connector

#### Type label

The type label contains the most important data for identification and use of the instrument:

- Instrument type
- Information about approvals
- Configuration information
- Technical data
- Serial number of the instrument
- QR code for device identification
- Manufacturer information

#### Documents and software

To find order data, documents or software related to your device, you have the following options:

- Move to "[www.vega.com](http://www.vega.com)" and enter in the search field the serial number of your instrument.
- Scan the QR code on the type label.
- Open the VEGA Tools app and enter the serial number under "*Documentation*".

## 3.2 Principle of operation

### Application area

VEGABAR 18 is suitable for applications in virtually all industries. It is used for the measurement of the following pressure types.

- Gauge pressure

### Measured products

Measured products are gases, vapours and liquids.

### Measured variables

The VEGABAR 18 is suitable for the measurement of the following process variables:

- Process pressure

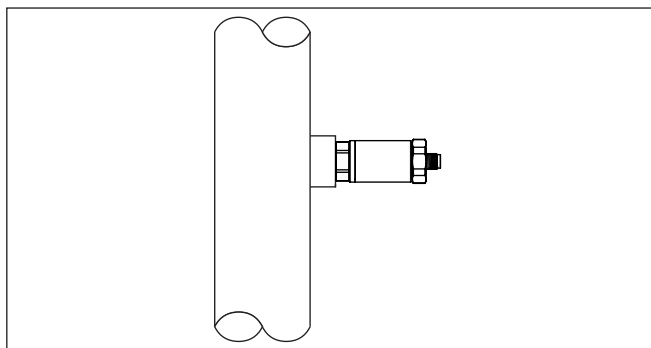


Fig. 2: Process pressure measurement VEGABAR 18

### Measuring system pressure

The sensor element is the Mini-CERTEC® measuring cell with robust ceramic diaphragm. The process pressure deflects the ceramic diaphragm and causes a capacitance change in the measuring cell. This capacitance change is converted into an electrical signal and outputted as measured value via the output signal.

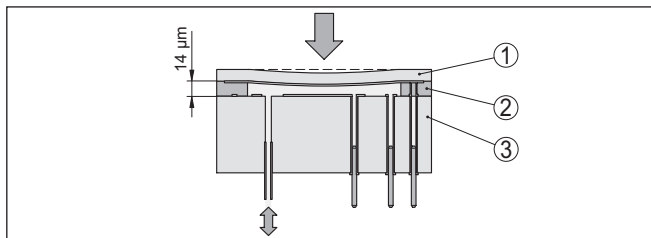


Fig. 3: Configuration of the Mini-CERTEC® measuring cell

- 1 Process diaphragm
- 2 Glass joint
- 3 Base element

### Pressure types

**Relative pressure:** the measuring cell is open to the atmosphere. The ambient pressure is detected in the measuring cell and compensated. It thus has no influence on the measured value.

**Recessed installation**

The recessed installation is particularly suitable for applications with gases, vapours and clear liquids. The measuring cell seal is positioned in front.

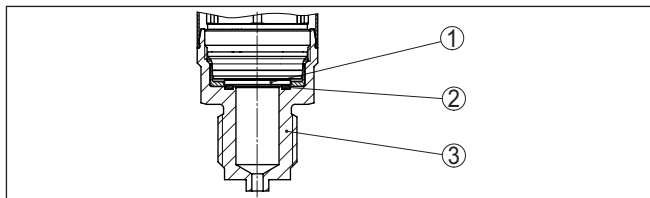


Fig. 4: Recessed installation of the measuring cell (example: thread G $\frac{1}{2}$  (EN 837), manometer connection)

- 1 Measuring cell
- 2 Seal for the measuring cell
- 3 Process fitting

**3.3 Adjustment**

The instrument offers no adjustment options.

**3.4 Packaging, transport and storage****Packaging**

Your instrument was protected by packaging during transport. Its capacity to handle normal loads during transport is assured by a test based on ISO 4180.

The packaging consists of environment-friendly, recyclable cardboard. For special versions, PE foam or PE foil is also used. Dispose of the packaging material via specialised recycling companies.

**Transport**

Transport must be carried out in due consideration of the notes on the transport packaging. Nonobservance of these instructions can cause damage to the device.

**Transport inspection**

The delivery must be checked for completeness and possible transit damage immediately at receipt. Ascertained transit damage or concealed defects must be appropriately dealt with.

**Storage**

Up to the time of installation, the packages must be left closed and stored according to the orientation and storage markings on the outside.

Unless otherwise indicated, the packages must be stored only under the following conditions:

- Not in the open
- Dry and dust free
- Not exposed to corrosive media
- Protected against solar radiation
- Avoiding mechanical shock and vibration
- Storage and transport temperature see chapter "Technical data - Ambient conditions"
- Relative moisture 20 ... 85 %

**Storage and transport temperature**

### 3.5 Accessories

The instructions for the listed accessories can be found in the download area on our homepage.

#### **Welded socket, threaded and hygienic adapter**

Welded sockets are used to connect the devices to the process.

Threaded and hygienic adapters enable simple adaptation of devices with standard threaded fittings to process-side hygiene connections.

#### **Mounting accessories**

The suitable mounting accessories for VEGABAR 18 includes siphons, blocking valves and measuring instrument holders.

## 4 Mounting

### 4.1 General instructions

#### Ambient conditions

The instrument is suitable for standard and extended ambient conditions acc. to DIN/EN/BS EN/IEC/ANSI/ISA/UL/CSA 61010-1. It can be used indoors as well as outdoors.

#### Process conditions



##### Note:

For safety reasons, the instrument must only be operated within the permissible process conditions. You can find detailed information on the process conditions in chapter "*Technical data*" of the operating instructions or on the type label.

Hence make sure before mounting that all parts of the instrument exposed to the process are suitable for the existing process conditions.

These are mainly:

- Active measuring component
- Process fitting
- Process seal

Process conditions in particular are:

- Process pressure
- Process temperature
- Chemical properties of the medium
- Abrasion and mechanical influences

#### Permissible process pressure (MWP) - Device

The permissible process pressure range is specified by "MWP" (Maximum Working Pressure) on the type label, see chapter "*Structure*". The MWP takes the element of the measuring cell and processing fitting combination with the weakest pressure into consideration and may applied permanently. The specification refers to a reference temperature of +20 °C (+68 °F). It also applies when a measuring cell with a higher measuring range than the permissible pressure range of the process fitting is installed order-related.

In addition, a temperature derating of the process fitting, e. g. with flanges, can limit the permissible process pressure range according to the respective standard.



##### Note:

In order to prevent damage to the device, a test pressure may only exceed the specified MWP briefly by 1.5 times at reference temperature. The pressure stage of the process fitting as well as the overload resistance of the measuring cell are taken into consideration here (see chapter "*Technical Data*").

#### Protection against moisture

Protect your instrument against moisture ingress through the following measures:

- Use a suitable connection cable (see chapter "*Connecting to power supply*")
- Tighten the cable gland or plug connector

- Lead the connection cable downward in front of the cable entry or plug connector

This applies mainly to outdoor installations, in areas where high humidity is expected (e.g. through cleaning processes) and on cooled or heated vessels.

### Ventilation and pressure compensation

Ventilation and pressure compensation for VEGABAR 18 are provided by an air-permeable, moisture-blocking filter element.

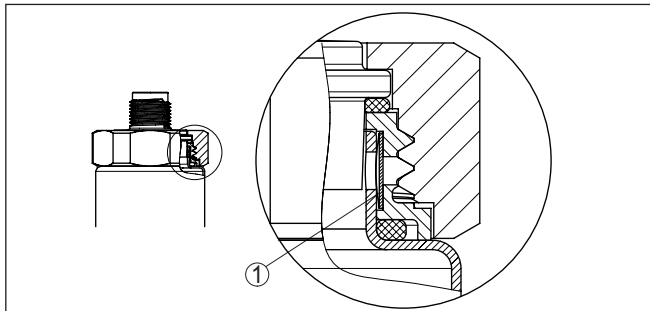


Fig. 5: Position of the filter element

1 Filter element

For effective ventilation, the filter element must always be free of buildup.



#### Caution:

Do not use a high-pressure cleaner. The filter element could be damaged, which would allow moisture into the housing.

### Screwing in

Devices with threaded fitting are screwed into the process fitting with a suitable wrench via the hexagon.

See chapter "Dimensions" for wrench size.



#### Warning:

The housing or the electrical connection may not be used for screwing in! Depending on the device version, tightening can cause damage, e. g. to the rotation mechanism of the housing.

### Permissible process pressure (MWP) - Mounting accessory

The permissible process pressure range is stated on the type label. The instrument should only be operated with these pressures if the mounting accessory used also fulfils these values. This should be ensured by suitable flanges, welded sockets, tension rings with Clamp connections, sealings, etc.

### Temperature limits

Higher process temperatures often mean also higher ambient temperatures. Make sure that the upper temperature limits stated in chapter "Technical data" for the environment of the electronics housing and connection cable are not exceeded.

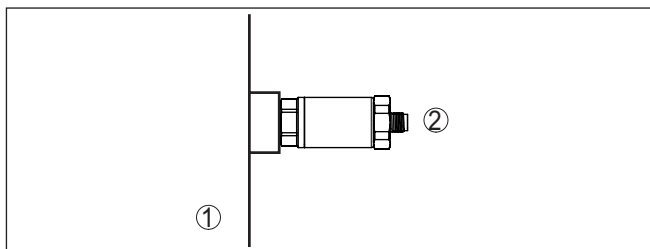


Fig. 6: Temperature ranges

- 1 Process temperature
- 2 Ambient temperature

## 4.2 Process pressure measurement

### In gases

Keep the following in mind when setting up the measuring system:

- Mount the instrument above the measuring point

Possible condensation can then drain off into the process line.

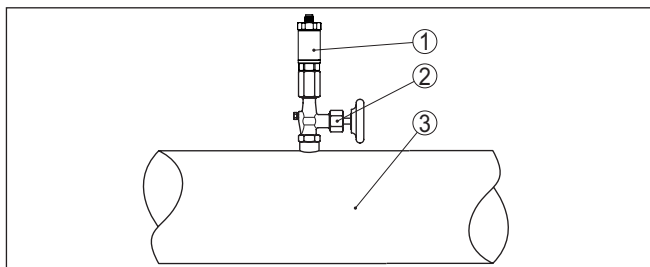


Fig. 7: Measurement setup for process pressure measurement of gases in pipelines (example)

- 1 VEGABAR 18
- 2 Shut-off valve
- 3 Pipeline

### In vapours

Keep the following in mind when setting up the measuring system:

- Connect via a siphon

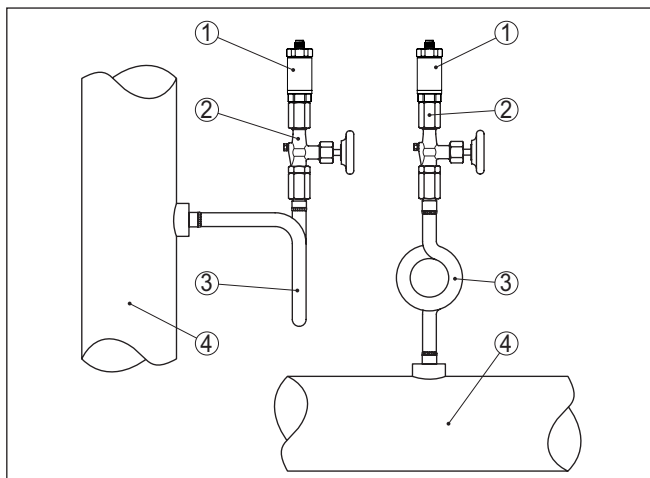


Fig. 8: Measurement setup for process pressure measurement of gases in pipelines (example)

- 1 VEGABAR 18
- 2 Shut-off valve
- 3 Siphon in U or circular form
- 4 Pipeline

A protective accumulation of water is formed through condensation in the pipe bends. Even in applications with hot steam, a medium temperature  $< 100\text{ }^{\circ}\text{C}$  on the transmitter is ensured.

## In liquids

Keep the following in mind when setting up the measuring system:

- Mount the instrument below the measuring point

The effective pressure line is always filled with liquid and gas bubbles can bubble up to the process line.

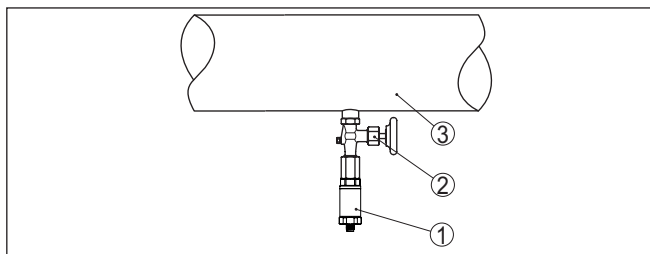


Fig. 9: Measurement setup for process pressure measurement of liquids in pipelines (example)

- 1 VEGABAR 18
- 2 Shut-off valve
- 3 Pipeline

## 5 Connecting to power supply

### 5.1 Preparing the connection

#### Safety instructions

Always keep in mind the following safety instructions:

- Carry out electrical connection by trained, qualified personnel authorised by the plant operator
- If overvoltage surges are expected, overvoltage arresters should be installed



#### Warning:

Only connect or disconnect in de-energized state.

#### Voltage supply

The data for power supply are specified in chapter "*Technical data*".



#### Note:

Power the instrument via an energy-limited circuit (power max. 100 W) acc. to IEC 61010-1, e.g.:

- Class 2 power supply unit (acc. to UL1310)
- SELV power supply unit (safety extra-low voltage) with suitable internal or external limitation of the output current
- PELV power supply unit (protective low voltage) with suitable internal or external limitation of the output current

Keep in mind the following additional factors that influence the operating voltage:

- Lower output voltage of the power supply unit under nominal load (e.g. with a sensor current of 20.5 mA or 22 mA in case of fault signal)
- Influence of additional instruments in the circuit (see load values in chapter "*Technical data*")

#### Connection cable

Use cable with round cross section. Depending on the plug connection, you have to select the outer diameter of the cable respectively so that the seal effect of the cable gland is ensured.

Depending on the connection method or signal output, the device is connected with standard two, three or four-wire cable without shielding.

### 5.2 Connection procedure

#### Plug according to ISO 4400

Proceed as follows:

1. Loosen the screw on the rear of the plug connector
2. Remove the plug connector and seal from VEGABAR 18
3. Remove the plug insert from the plug housing

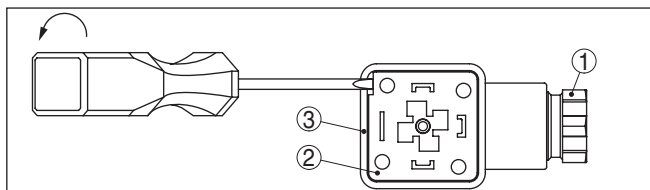


Fig. 10: Loosen the plug insert

- 1 Cable gland
- 2 Plug insert
- 3 Plug housing

- 4. Remove approx. 5 cm of the cable mantle, strip approx. 1 cm insulation from the individual wires
- 5. Lead the cable through the cable gland into the plug housing
- 6. Connect the wire ends to the screw terminals according to the wiring plan

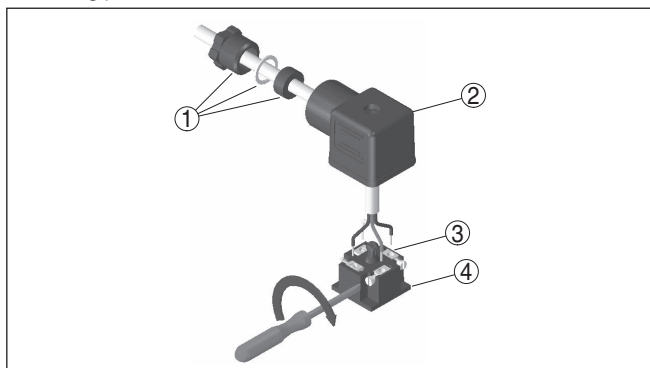


Fig. 11: Connection to the screw terminals

- 1 Cable gland
- 2 Plug housing
- 3 Plug insert
- 4 Plug seal

- 7. Snap the plug insert into the plug housing and insert the sensor seal
- 8. Plug the plug insert with seal to VEGABAR 18 and tighten the screw

The electrical connection is finished.

M12 x 1 plug

5.3 Wiring plan

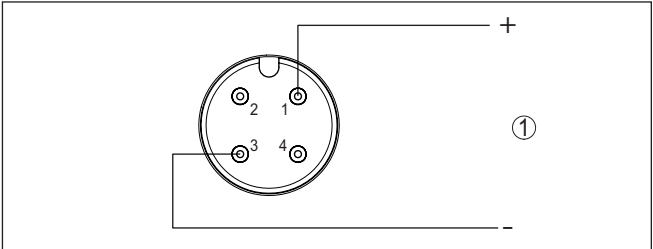


Fig. 12: Wiring plan - two-wire 4 ... 20 mA - M12 x 1 plug  
1 Voltage supply and signal output

| Contact, plug connector | Function/Polarity               |
|-------------------------|---------------------------------|
| 1                       | Voltage supply, signal output/+ |
| 2                       | Free                            |
| 3                       | Voltage supply, signal output/- |
| 4                       | Free                            |

Plug according to ISO 4400

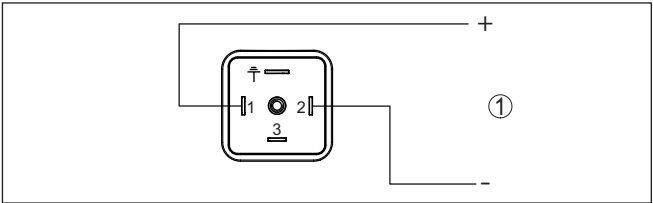


Fig. 13: Wiring plan - two-wire 4 ... 20 mA - plug according to ISO 4400  
1 Voltage supply and signal output

| Contact, plug connector                                                             | Function/Polarity                         |
|-------------------------------------------------------------------------------------|-------------------------------------------|
| 1                                                                                   | Voltage supply, signal output/+           |
| 2                                                                                   | Voltage supply, signal output/-           |
| 3                                                                                   | Free                                      |
|  | Electrically connected with metal housing |

5.4 Switch-on phase

After switching on, the device first carries out a self-check:

- Internal check of the electronics
- The output signal jumps to the set fault current

The current measured value is then output on the signal cable.

## 6 Diagnostics and servicing

### 6.1 Maintenance

#### Maintenance

If the device is used properly, no special maintenance is required in normal operation.

#### Precaution measures against buildup

In some applications, product buildup on the diaphragm can influence the measuring result. Depending on the sensor and application, take precautions to ensure that heavy buildup, and especially a hardening thereof, is avoided.

#### Cleaning

The cleaning helps that the type label and markings on the instrument are visible.

Take note of the following:

- Use only cleaning agents which do not corrode the housings, type label and seals
- Use only cleaning methods corresponding to the housing protection rating

### 6.2 Rectify faults

#### Reaction when malfunction occurs

The operator of the system is responsible for taking suitable measures to rectify faults.

#### Causes of malfunction

The device offers maximum reliability. Nevertheless, faults can occur during operation. These may be caused by the following, e.g.:

- Sensor
- Process
- Voltage supply
- Signal processing

#### Fault rectification

The first measures are:

- Evaluation of fault messages
- Checking the output signal
- Treatment of measurement errors

A smartphone/tablet with the adjustment app or a PC/notebook with the software PACTware and the suitable DTM offer you further comprehensive diagnostic possibilities. In many cases, the causes can be determined in this way and the faults eliminated.

#### Reaction after fault rectification

Depending on the reason for the fault and the measures taken, the steps described in chapter "Setup" must be carried out again or must be checked for plausibility and completeness.

#### 24 hour service hotline

Should these measures not be successful, please call in urgent cases the VEGA service hotline under the phone no. **+49 1805 858550**.

The hotline is also available outside normal working hours, seven days a week around the clock.

Since we offer this service worldwide, the support is provided in English. The service itself is free of charge, the only costs involved are the normal call charges.

6.3 Diagnosis, fault messages

4 ... 20 mA signal

Connect a multimeter in the suitable measuring range according to the wiring plan. The following table describes possible errors in the current signal and helps to eliminate them:

| Error                                               | Cause                                               | Rectification                                                    |
|-----------------------------------------------------|-----------------------------------------------------|------------------------------------------------------------------|
| 4 ... 20 mA signal missing                          | Electrical connection faulty                        | Check connection, correct, if necessary                          |
|                                                     | Voltage supply missing                              | Check cables for breaks; repair if necessary                     |
|                                                     | Operating voltage too low, load resistance too high | Check, adapt if necessary                                        |
| Current signal greater than 22 mA, less than 3.6 mA | Sensor electronics defective                        | Replace device or send in for repair depending on device version |

6.4 How to proceed if a repair is necessary

On our homepage you will find detailed information on how to proceed in the event of a repair.

So that we can carry out the repair quickly and without queries, generate a instrument return form there with the data of your device.

The following is required:

- The serial number of the instrument
- A short description of the fault
- Details of the medium, if applicable

Print the generated instrument return form.

Clean the instrument and pack it damage-proof.

Send the printed instrument return form and possibly a safety data sheet together with the device.

You will find the address for the return on the generated instrument return form.

## 7 Dismount

### 7.1 Dismounting steps

To remove the device, carry out the steps in chapters "*Mounting*" and "*Connecting to power supply*" in reverse.



**Warning:**

When dismounting, pay attention to the process conditions in vessels or pipelines. There is a risk of injury, e.g. due to high pressures or temperatures as well as aggressive or toxic media. Avoid this by taking appropriate protective measures.

### 7.2 Disposal



Pass the instrument on to a specialised recycling company and do not use the municipal collecting points.

Remove any batteries in advance, if they can be removed from the device, and dispose of them separately.

If personal data is stored on the old device to be disposed of, delete it before disposal.

If you have no way to dispose of the old instrument properly, please contact us concerning return and disposal.

## 8 Certificates and approvals

### 8.1 Approvals for Ex areas

Approved versions for use in hazardous areas are available or in preparation for the device or the device series.

You can find the relevant documents on our homepage.

### 8.2 Conformity

The device complies with the legal requirements of the applicable country-specific directives or technical regulations. We confirm conformity with the corresponding labelling.

The corresponding conformity declarations can be found on our homepage.

Due to the design of its process fittings, the device does not subject of EU pressure device directive if it is operated at process pressures  $\leq 200$  bar (good engineering practice).

### 8.3 NAMUR recommendations

NAMUR is the automation technology user association in the process industry in Germany. The published NAMUR recommendations are accepted as the standard in field instrumentation.

The device fulfils the requirements of the following NAMUR recommendations:

- NE 21 – Electromagnetic compatibility of equipment
- NE 43 – Signal level for fault information from measuring transducers

For further information see [www.namur.de](http://www.namur.de).

### 8.4 Environment management system

Protection of the environment is one of our most important duties. That is why we have introduced an environment management system with the goal of continuously improving company environmental protection. The environment management system is certified according to DIN EN ISO 14001.

Help us to meet these requirements and observe the environmental instructions in the chapters "*Packaging, transport and storage*", "*Disposal*" of this instructions manual.

## 9 Supplement

### 9.1 Technical data

#### Note for approved instruments

The technical data in the respective safety instructions which are included in delivery are valid for approved instruments (e.g. with Ex approval). These data can differ from the data listed herein, for example regarding the process conditions or the voltage supply.

All approval documents can be downloaded from our homepage.

#### Materials and weights

##### Materials, wetted parts

|                                                     |                                                                     |
|-----------------------------------------------------|---------------------------------------------------------------------|
| Process fitting                                     | 316L                                                                |
| Diaphragm                                           | Sapphire-ceramic® (> 99.9 % Al <sub>2</sub> O <sub>3</sub> ceramic) |
| Measuring cell seal                                 | FKM (VP2/A)                                                         |
| Seal for process fitting (in the scope of delivery) |                                                                     |
| – Thread G½ (EN 837), manometer connection          | Klingersil C-4400                                                   |
| – Thread G½, inside G¼ (ISO 228-1)                  | Klingersil C-4400                                                   |

##### Materials, non-wetted parts

|                                      |                                           |
|--------------------------------------|-------------------------------------------|
| Electronics housing                  | 316L                                      |
| M12 x 1 plug connector               |                                           |
| – Contact support                    | PA                                        |
| – Contacts                           | CuZn, nickel layer and 0.8 µm gold-plated |
| Plug connector according to ISO 4400 |                                           |
| – Contact, housing plug              | PA                                        |
| – Lid screw                          | StSt                                      |
| – Contact surface                    | Sn                                        |
| – Plug seal                          | Silicone                                  |
| Weight                               | approx. 0.25 kg (0.55 lbs)                |

#### Torques

|                                            |                      |
|--------------------------------------------|----------------------|
| Max. torques                               |                      |
| – Thread G½ (EN 837), manometer connection | 50 Nm (36.88 lbf ft) |
| – Thread G½, inside G¼ (ISO 228-1)         | 50 Nm (36.88 lbf ft) |

#### Input variable

The specifications are only an overview and refer to the measuring cell. Limitations due to the material and version of the process fitting as well as the selected pressure type are possible. The specifications on the nameplate apply.<sup>1)</sup>

<sup>1)</sup> Data on overload capability apply for reference temperature.

**Nominal measuring ranges and overload capability in bar/kPa**

| Nominal range                 | Overload capacity, max. pressure | Overload capacity, min. pressure |
|-------------------------------|----------------------------------|----------------------------------|
| 0 ... +0.1 bar/0 ... +10 kPa  | +15 bar/+1500 kPa                | -0.2 bar/-20 kPa                 |
| 0 ... +0.4 bar/0 ... +40 kPa  | +30 bar/+3000 kPa                | -0.8 bar/-80 kPa                 |
| 0 ... +1 bar/0 ... +100 kPa   | +35 bar/+3500 kPa                | -1 bar/-100 kPa                  |
| 0 ... +2.5 bar/0 ... +250 kPa | +50 bar/+5000 kPa                | -1 bar/-100 kPa                  |
| 0 ... +5 bar/0 ... +500 kPa   | +65 bar/+6500 kPa                | -1 bar/-100 kPa                  |
| 0 ... +10 bar/0 ... +1000 kPa | +90 bar/+9000 kPa                | -1 bar/-100 kPa                  |
| 0 ... +25 bar/0 ... +2500 kPa | +130 bar/+13000 kPa              | -1 bar/-100 kPa                  |

**Nominal measuring ranges and overload capacity in psi**

| Nominal range   | Overload capacity, max. pressure | Overload capacity, min. pressure |
|-----------------|----------------------------------|----------------------------------|
| 0 ... +1.5 psig | +225 psig                        | -3 psig                          |
| 0 ... +5 psig   | +435 psig                        | -12 psig                         |
| 0 ... +15 psig  | +525 psig                        | -14.51 psig                      |
| 0 ... +30 psig  | +725 psig                        | -14.51 psig                      |
| 0 ... +75 psig  | +950 psig                        | -14.51 psig                      |
| 0 ... +150 psig | +1300 psig                       | -14.51 psig                      |
| 0 ... +300 psig | +1900 psig                       | -14.51 psig                      |

**Switch-on phase**

|                                            |               |
|--------------------------------------------|---------------|
| Start-up time with operating voltage $U_B$ | $\leq 1$ s    |
| Starting current for run-up time           | $\leq 3.6$ mA |

**Output variable - two-wire 4 ... 20 mA**

|                             |                                        |
|-----------------------------|----------------------------------------|
| Output signal               | 4 ... 20 mA - passive                  |
| Connection technology       | Two-wire                               |
| Range of the output signal  | 3.8 ... 20.5 mA                        |
| Signal resolution           | 5 $\mu$ A                              |
| Fault signal output current | 3.6 mA                                 |
| Load                        | See load resistance under Power supply |
| Transferred measured value  | Pressure                               |

**Dynamic behaviour output**

Dynamic characteristics - Current output<sup>2)</sup>

<sup>2)</sup> Depending on medium and temperature

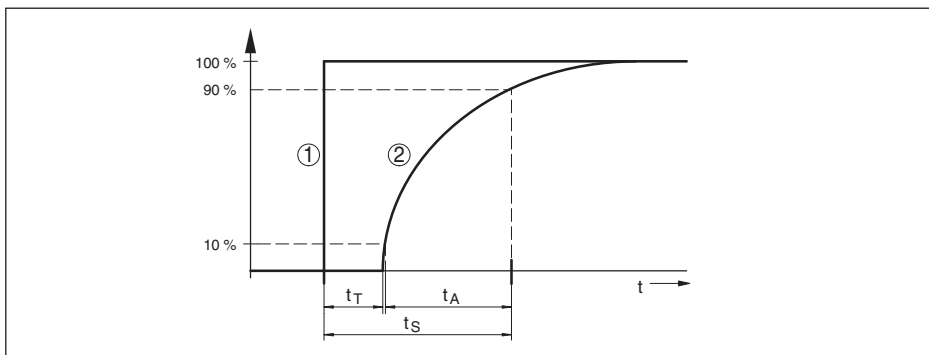


Fig. 14: Behaviour the current output in case of sudden change of the process variable.  $t_T$ : dead time;  $t_A$ : rise time;  $t_S$ : jump response time

- 1 Process variable  
2 Output signal

| Size                                      | Time          |
|-------------------------------------------|---------------|
| Dead time                                 | $\leq 30$ ms  |
| Rise time (10 ... 90 %)                   | approx. 15 ms |
| Step response time (ti: 0 s, 10 ... 90 %) | approx. 45 ms |

#### Reference conditions and influencing variables (according to DIN EN 60770-1)

Reference conditions according to DIN EN 61298-1

- Temperature +15 ... +25 °C (+59 ... +77 °F)
- Relative humidity 45 ... 75 %
- Air pressure 860 ... 1060 mbar/86 ... 106 kPa (12.5 ... 15.4 psig)

Determination of characteristics Limit point adjustment according to IEC 61298-2

Characteristic curve Linear

Reference installation position upright, diaphragm points downward

Influence of the installation position  $< 0.2$  mbar/20 Pa (0.003 psig)

Max. measurement deviation with electromagnetic interference  $< \pm 80$   $\mu$ A

#### Deviation (according to IEC 60770)<sup>3)</sup>

Deviation  $< 0.5$  %

<sup>3)</sup> Relating to the nominal measuring range, incl. non-linearity, hysteresis and non-reproducibility.

### Influence of the medium or ambient temperature

Average temperature coefficient of the zero signal

- In the compensated temperature range<sup>4)</sup> < 0.15 %/10 K
- Outside the compensated temperature range typ. 0.3 %/10 K

### Additional factor through Turn Down

The additional factor F<sub>TD</sub> through Turn down is calculated according to the following formula:

$$F_{TD} = 0.5 \times TD + 0.5$$

In the table, example values for typical Turn downs are listed.

| Turn Down              | TD : 1 | TD 2.5 : 1 | TD 5 : 1 | TD 10 : 1 | TD 20 : 1 |
|------------------------|--------|------------|----------|-----------|-----------|
| Factor F <sub>TD</sub> | 1      | 1.75       | 3        | 5.5       | 10.5      |

### Long-term stability (according to DIN 16086)

Specifications refer to the set span. Turn down (TD) is the ratio: nominal measuring range/set span.

| Time period | Long-term drift zero signal and output span |
|-------------|---------------------------------------------|
| One year    | < 0.1 % x TD                                |
| Five years  | < 0.5 % x TD                                |
| Ten years   | < 1.0 % x TD                                |

### Ambient conditions

|                                   |                                  |
|-----------------------------------|----------------------------------|
| Ambient temperature               | -40 ... +70 °C (-40 ... +158 °F) |
| Storage and transport temperature | -40 ... +70 °C (-40 ... +158 °F) |

### Mechanical environmental conditions

|                            |                                                     |
|----------------------------|-----------------------------------------------------|
| Vibrations (oscillations)  | Class 4M8 acc. to IEC 60721-3-4 (5 g, 4 ... 200 Hz) |
| Impacts (mechanical shock) | Class 6M4 acc. to IEC 60721-3-6 (50 g; 2.3 ms)      |
| Impact resistance          | IK06 acc. to IEC 62262                              |

### Process conditions

|                              |                                                         |
|------------------------------|---------------------------------------------------------|
| Process temperature          | -40 ... +100 °C (-40 ... +212 °F)                       |
| Permissible process pressure | see specification "MWP" on the type label <sup>5)</sup> |

### Electromechanical data

Angled plug connector

- Version 4-pin according to ISO 4400
- Cable gland M16 x 1.5 (for cable diameter 4.5 ... 10 mm)
- Screw terminals for cable cross-section up to 1.5 mm<sup>2</sup> (AWG 16)

<sup>4)</sup> 0 ... +100 °C (+32 ... +212 °F)

<sup>5)</sup> MWP: Maximum Working Pressure

|                      |                                      |
|----------------------|--------------------------------------|
| – Conductor version  | Massive wire or strand               |
| Round plug connector | 4-pole with M12 x 1 screw connection |

### Voltage supply

|                                                           |                                                            |
|-----------------------------------------------------------|------------------------------------------------------------|
| Operating voltage $U_B$                                   | 12 ... 35 V DC                                             |
| Reverse voltage protection                                | Integrated                                                 |
| Permissible residual ripple                               |                                                            |
| – for $U_N$ 12 V DC ( $12\text{ V} < U_B < 18\text{ V}$ ) | $\leq 0.7\text{ V}_{\text{eff}}$ (16 ... 400 Hz)           |
| – for $U_N$ 24 V DC ( $18\text{ V} < U_B < 35\text{ V}$ ) | $\leq 1.0\text{ V}_{\text{eff}}$ (16 ... 400 Hz)           |
| Load resistor                                             |                                                            |
| – Calculation                                             | $(U_B - U_{\text{min}})/0.022\text{ A}$                    |
| – Example - $U_B = 24\text{ V DC}$                        | $(24\text{ V} - 12\text{ V})/0.022\text{ A} = 545\ \Omega$ |

### Electrical protective measures<sup>6)</sup>

|                      |                                           |
|----------------------|-------------------------------------------|
| Potential separation | Electronics potential free up to 500 V AC |
| Protection rating    |                                           |

| Connection technology      | Protection according to EN 60529/IEC 529 | Protection according to UL 50 |
|----------------------------|------------------------------------------|-------------------------------|
| M12 x 1 plug               | IP66/IP67                                | Type 4X                       |
| Plug according to ISO 4400 | IP65                                     |                               |

|                          |                   |
|--------------------------|-------------------|
| Altitude above sea level | 5000 m (16404 ft) |
| Protection class         | III               |
| Pollution degree         | 2                 |

<sup>6)</sup> Achieving a UL-approved degree of protection requires the use of UL-certified plugs or connection sets. This is fulfilled when using the supplied plug according to ISO 4400.

## 9.2 Dimensions

### Housing and connections

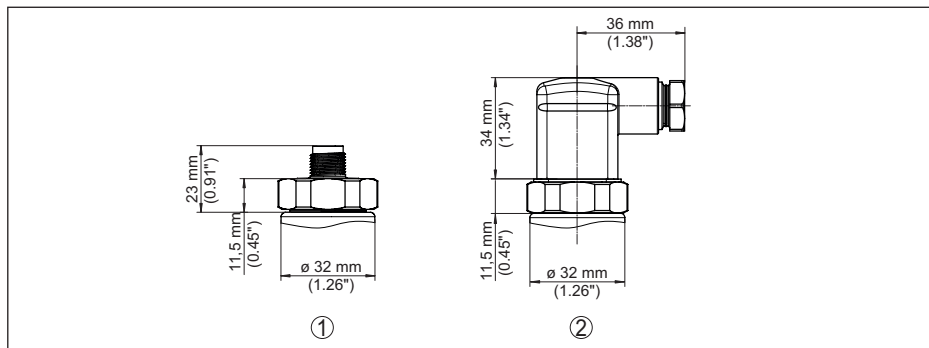


Fig. 15: VEGABAR 18 housing

1 M12 x 1 plug connector

2 Plug connector according to ISO 4400

### VEGABAR 18, threaded fitting not front-flush

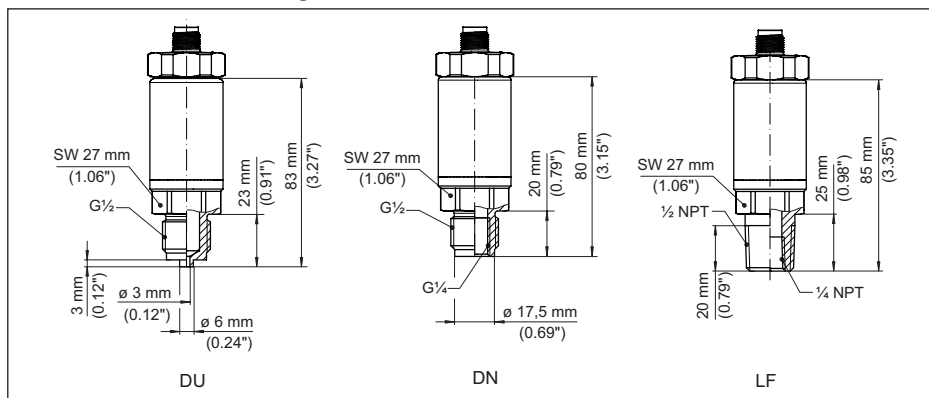


Fig. 16: VEGABAR 18, threaded fitting not front-flush

DU Thread  $G\frac{1}{2}$  (EN 837), manometer connection

DN Thread  $G\frac{1}{2}$ , inside  $G\frac{1}{4}$  (ISO 228-1)

LF Thread  $\frac{1}{2}$  NPT, inside  $\frac{1}{4}$  NPT (ASME B1.20.1)

### 9.3 Industrial property rights

VEGA product lines are global protected by industrial property rights. Further information see [www.vega.com](http://www.vega.com).

VEGA Produktfamilien sind weltweit geschützt durch gewerbliche Schutzrechte.

Nähere Informationen unter [www.vega.com](http://www.vega.com).

Les lignes de produits VEGA sont globalement protégées par des droits de propriété intellectuelle. Pour plus d'informations, on pourra se référer au site [www.vega.com](http://www.vega.com).

VEGA lineas de productos están protegidas por los derechos en el campo de la propiedad industrial. Para mayor información revise la pagina web [www.vega.com](http://www.vega.com).

Линии продукции фирмы ВЕГА защищаются по всему миру правами на интеллектуальную собственность. Дальнейшую информацию смотрите на сайте [www.vega.com](http://www.vega.com).

VEGA系列产品在全球享有知识产权保护。

进一步信息请参见网站[www.vega.com](http://www.vega.com)。

### 9.4 Licensing information for open source software

Open source software components are also used in this device. A documentation of these components with the respective license type, the associated license texts, copyright notes and disclaimers can be found on our homepage.

### 9.5 Trademark

All the brands as well as trade and company names used are property of their lawful proprietor/originator.

Printing date:

# VEGA

For more VEGA product please visit: [www.ainstru.com](http://www.ainstru.com)

Mail: [Sales@ainstru.com](mailto:Sales@ainstru.com)

All statements concerning scope of delivery, application, practical use and operating conditions of the sensors and processing systems correspond to the information available at the time of printing.

Subject to change without prior notice

© VEGA Grieshaber KG, Schiltach/Germany 2025

55575-EN-251113

VEGA Grieshaber KG  
Am Hohenstein 113  
77761 Schiltach  
Germany

Phone +49 7836 50-0  
E-mail: [info.de@vega.com](mailto:info.de@vega.com)  
[www.vega.com](http://www.vega.com)